

# **TEKNIKAL SPESIFIKASI**

## Cirrus CCD Detector



The Cirrus CCD is an advanced, multi-pipe aspirating detector that uses Cloud Chamber Detection (CCD) technology to provide early warning of fire. This technology ensures the highest level of sensitivity, enabling the device to detect even the slightest traces of combustion particles, even before visible smoke particles are present.

### Standards / Approvals

- EN 54-17, EN 54-20
- AS 7240-20
- UKCA
- CE

### Technical Specification

Supply Voltage	20 - 28VDC
Current Consumption @ 24VDC, 100% Fan 4 pipe	522mA quiescent   622mA alarm (1 pipe) 840mA quiescent   940mA alarm (Scanner 4 pipe)
Operating Temperature Range	0°C to 45°C (32°F to 113°F)
Temperature Range Tested to EN54-20	0°C to 55°C (32°F to 131°F)
Application Sampled Air Temperature	-20°C to 60°C (-4°F to 140°F)
Humidity	10 - 93%RH (no icing / non-condensing)
IP Rating	IP30
Cable access	10 x 20mm knock outs
Cable Termination	Screw terminal blocks (0.2 - 2.5mm <sup>2</sup> , 30 - 12AWG)
Pipe Outer Diameter	25mm, push to fit tapered inlet
Alarm Indications	Pre-alarm, Fire 1, Fire 2, Fire 3
Other Indications	Supply Healthy, General Fault, 7inch LCD colour touch Screen Display
Fault Contact	Rated at 30VDC 1A maximum [Normally closed]
Programmable Output Contacts	5 contacts rated 30VDC 1A [Volt-free change over contacts with 28 programming options]
Programmable Inputs	3 monitored inputs that may be configured for Isolate, Reset, Silence, Day/Night, Battery Fault and Mains Fault
Camera	6 Protec specified IP cameras
Event Log / Data Retention	24,000 events stored on FIFO basis (alarms, actions, faults and data points) (Approx 30 day historical graph data)
Variable Sensitivity Settings	7 day programmable settings with 2 time zones per day. Day-time/Night-time setting
Sensitivity Range	Incipient Detection Range: 0.002micron to 1.0micron in diameter. Concentrations of 10,000 particles per cc to 10 million particles per cc. Carbon Monoxide Detection Range: 1 to 150 ppm

## Cirrus CCD Detector

### Technical Specifications Continued

Threshold Settings Recommended Maximum	Class A – 8 holes per pipe @ 115 Alarm Level Class B – 14 holes per pipe @ 145 Alarm Level Class C – 16 holes per pipe @ 400 Alarm Level
Threshold Settings Compliant Maximum EN 54-20	Class A – 8 holes per pipe @ 117 Alarm Level Class B – 14 holes per pipe @ 147 Alarm Level Class C – 16 holes per pipe @ 752 Alarm Level
Sampling Pipe Network	Number of inlet ports: Up to four Pipe Network Design Tool: ProFlow Maximum pipe length: Specific to individual design. To be compliant to local design codes, and verified by ProFlow.
Airflow Monitoring	'High Airflow' and 'Low Airflow' fault monitoring
Weight	3.5kg (7.7lbs)
Dimensions (mm)	380(H) x 250(W) x 137(D)

### Application Guide

**Class A - High Sensitivity Applications include:** - Computer rooms, Cleanrooms, Data Centres, Control Rooms, Valve Halls, Archive Storage, Anechoic Chambers, EDP areas and areas where very high sensitivity is critical.

**Class B - Enhanced Sensitivity Applications include:** - Historic Buildings, Museums, Hospitals, Airports, Cathedrals, Theatres, Art Galleries, General Warehouses, Atria, Indoor Stadiums, Power and Control Cabinets

**Class C - Normal Sensitivity and Harsh Environment Applications include:** - Cold Storage Facilities, Specialist Production Facilities, Food Processing Areas, Paper Production Facilities, Transportation Terminals, Dusty Production Facilities, Cable Tunnels and Applications where moderate amounts of dust can be expected.

### Product Codes

1 Pipe (with display)	61-986-C1	1 Pipe (no display)	61-986-C1ND
2 Pipe (with display)	61-986-C2S	2 Pipe (no display)	61-986-C2SND
3 Pipe (with display)	61-986-C3S	3 Pipe (no display)	61-986-C3SND
4 Pipe (with display)	61-986-C4S	4 Pipe (no display)	61-986-C4SND

Data within this document are subject to change without notice.

Protec Fire and Security Group Ltd. Protec House, Churchill Way, Nelson, BB9 6RT  
[www.protec.co.uk](http://www.protec.co.uk) | [sales@protec.co.uk](mailto:sales@protec.co.uk) | [support.protec.co.uk](mailto:support.protec.co.uk) | +44 1282 717171

## Cirrus HYBRID Detector



The Cirrus HYBRID aspirating detector combines Scatter and Cloud Chamber detection technologies into one unit. With the ability to cover up to four pipes, this dual technology approach provides excellent sensitivity for detecting fire and smoke while significantly reducing false alarms.

### Standards / Approvals

- EN 54-17, EN 54-20
- AS 7240-20
- UKCA
- CE

### Technical Specification

	Cirrus HYBRID (Scanner)	Cirrus HYBRID (Non-Scanner)
Supply Voltage	20 - 28VDC	
Current Consumption @ 24VDC, 100% Fan 4 pipe	840mA quiescent   940mA alarm	685mA quiescent   785mA alarm
Operating Temperature Range	0°C to 45°C (32°F to 113°F)	
Temperature Range Tested to EN54-20	0°C to 55°C (32°F to 131°F)	
Application Sampled Air Temperature	-20°C to 60°C (-4°F to 140°F)	
Humidity	10 - 93%RH (no icing / non-condensing)	
IP Rating	IP30	
Cable access	10 x 20mm knock outs	
Cable Termination	Screw terminal blocks (0.2 - 2.5mm <sup>2</sup> , 30 - 12AWG)	
Pipe Outer Diameter	25mm, push to fit tapered inlet	
Alarm Indications	Pre-alarm, Fire 1, Fire 2, Fire 3	
Other Indications	Supply Healthy, General Fault, 7inch LCD colour touch Screen Display	
Fault Contact	Rated at 30VDC 1A maximum [Normally closed]	
Programmable Output Contacts	5 contacts rated 30VDC 1A [Volt-free change over contacts with 28 programming options]	
Programmable Inputs	3 monitored inputs that may be configured for Isolate, Reset, Silence, Day/Night, Battery Fault and Mains Fault	
Camera	6 Protec specified IP cameras	
Event Log / Data Retention	24,000 events stored on FIFO basis (alarms, actions, faults and data points) (Approx 30 day historical graph data)	
Variable Sensitivity Settings	7 day programmable settings with 2 time zones per day. Day-time/Night-time setting	
Sensitivity Range	Incipient Detection Range: 0.002micron to 1.0micron in diameter. Concentrations of 10,000 particles per cc to 10 million particles per cc.	
	Optical Detection Range: 0.01%obs/m to 20%obs/m	

## Cirrus HYBRID Detector

### Technical Specifications Continued

	Cirrus HYBRID (Scanner)	Cirrus HYBRID (Non-Scanner)
Threshold Settings recommended maximum	Class A – 11 holes per pipe @ 130CFS Class B – 22 holes per pipe @ 400CFS Class C – 44 holes per pipe @ 600CFS	Class A – 34 holes per detector @ 130CFS Class B – 44 holes per detector @ 400CFS Class C – 44 holes per detector @ 600CFS
Threshold Settings Complaint maximum EN 54-20	Class A – 11 holes per pipe @ 549CFS Class B – 22 holes per pipe @ 599CFS Class C – 44 holes per pipe @ 1000CFS	Class A – 34 holes per detector @ 130CFS Class B – 44 holes per detector @ 422CFS Class C – 44 holes per detector @ 1000CFS
Sampling Pipe Network	Number of inlet ports: Up to four Pipe Network Design Tool: ProFlow Maximum pipe length: Specific to individual design. To be compliant to local design codes, and verified by ProFlow.	
Airflow Monitoring	'High Airflow' and 'Low Airflow' fault monitoring	
Weight	3.5kg (7.7lbs)	
Dimensions (mm)	380(H) x 250(W) x 137(D)	

### Application Guide

**Class A - High Sensitivity Applications include:** - Computer rooms, Cleanrooms, Data Centres, Control Rooms, Valve Halls, Archive Storage, Anechoic Chambers, EDP areas and areas where very high sensitivity detection is critical.

**Class B - Enhanced Sensitivity Applications include:** - Historic Buildings, Museums, Hospitals, Airports, Cathedrals, Theatres, Art Galleries, General Warehouses, Atria, Indoor Stadiums, Power and Control Cabinets.

**Class C - Normal Sensitivity and Harsh Environment Applications include:** - Cold Storage Facilities, Specialist Production Facilities, Food Processing Areas, Transportation Terminals, Inaccessible Voids and General Warehousing.

### Product Codes

		HYBRID 1 Pipe	61-986-H1
HYBRID 2 Pipe Scanner	61-986-H2S	HYBRID 2 Pipe	61-986-H2
HYBRID 3 Pipe Scanner	61-986-H3S	HYBRID 3 Pipe	61-986-H3
HYBRID 4 Pipe Scanner	61-986-H4S	HYBRID 4 Pipe	61-986-H4
		HYBRID Non-display 1 Pipe	61-986-H1ND
HYBRID Non-display 2 Pipe Scanner	61-986-H2SND	HYBRID Non-display 2 Pipe	61-986-H2ND
HYBRID Non-display 3 Pipe Scanner	61-986-H23ND	HYBRID Non-display 3 Pipe	61-986-H3ND
HYBRID Non-display 4 Pipe Scanner	61-986-H24ND	HYBRID Non-display 4 Pipe	61-986-H4ND

Note: Non-scanning detectors (standard detectors) - can have up to four sampling pipes which share a common Cloud Chamber to provide fire particle detection. Each pipe inlet is provided with an individual Scatter Chamber Detector to provide optical smoke particle detection. This does not provide individual pipe identification of the Combined Fire & Smoke signals.

Scanning detectors - can have up to four sampling pipes. The air entering each pipe inlet is directed through the Cloud Chamber to provide fire particle detection and an individual Scatter Chamber Detector to provide optical smoke particle detection. This provides individual pipe identification of the Combined Fire & Smoke signals.



### KIT CONTENTS

- Cirrus HYBRID H2 - 2 pipe aspirating fire & smoke detector
- Tripod demonstration stand and support bracket
- 24vdc power supply and connector
- In-built USB B/A connector for laptop connection
- In-built RJ45 connector for camera connection
- Sales demonstration cloud chamber glass flask and bulb

### OPTIONAL ITEMS



**ProPoint PLUS 2 Detector**  
c/w 2 x OPT/CO SCD's @ £430.00



**HiKVision IP dome camera**  
c/w psu @ £182.00



**Samsonite S-Cure rigid suitcase**  
with wheels @ £225.00

The Cirrus HYBRID sales demonstration kit has been specifically designed for Protec Distributors and Partner companies and provides a self contained kit to enable client presentations to be given.

The kit comprises a Cirrus HYBRID two pipe aspirating fire & smoke detector, laptop style power supply, bracket and tripod stand.

Also included is a glass flask and bulb sales tool to provide a visual presentation of cloud chamber technology.

A ProPoint PLUS aspirating smoke detector is an optional item which is interchangeable with the HYBRID on the tripod stand.

A HYBRID camera and portable lockable case are also offered as options.

#### Sales Demonstration Kit

Order reference code: WSP28033-FA  
@ £1,345.00

## ProPoint PLUS Detector



The ProPoint PLUS aspirating detection system is highly advanced and reliable. It can detect up to four different pipes per aspirator, each with its own identifiable Scatter Chamber Detector (SCD) module to detect smoke at the earliest possible stage.

### Standards / Approvals

- EN 54-17, EN 54-20
- AS 7240-20
- UKCA
- CE

### Technical Specification

	ProPoint PLUS OPCO	ProPoint PLUS OP4S
Supply Voltage	21 - 28VDC	
Current Consumption @ 24VDC, 100% Fan 4 pipe	580mA quiescent   620mA alarm	
Temperature Range Tested to EN54-20	-10°C to 55°C (32°F to 131°F)	
Application Sampled Air Temperature	-20°C to 60°C (-4°F to 140°F)	
Humidity	10 - 93%RH (no icing / non-condensing)	
IP Rating	IP30	
Cable access	10 x 20mm knock outs	
Cable Termination	Screw terminal blocks (0.2 - 2.5mm <sup>2</sup> , 30 - 12AWG)	
Pipe Outer Diameter	25mm, push to fit tapered inlet	
Alarm Indications	Pre-alarm, Fire	Pre-alarm, Fire 1, Fire 2, Fire 3
Other Indications	Supply Healthy, General Fault, OLED Display with four navigation buttons	
Fault Contact	Rated at 30VDC 1A maximum [Normally closed]	
Programmable Output Contacts	5 contacts rated 30VDC 1A [Volt-free change over contacts with 28 programming options]	
Programmable Inputs	3 monitored inputs that may be configured for Isolate, Reset, Silence, Battery Fault and Mains Fault	
Event Log / Data Retention	24,000 events stored on FIFO basis (alarms, actions, faults and data points) (Approx 30 day historical graph data)	
Sensitivity Range	Optical Detection Range: 0.12%obs/m to 11%obs/m	Optical Detection Range: 0.02%obs/m to 6.0%obs/m
	Carbon Monoxide Detection Range: 1 to 150 ppm	Hole Sensitivity Range: 0.5%obs/m to 6.0%obs/m

# ProPoint PLUS Detector

## Technical Specifications Continued

	ProPoint PLUS OPCO	ProPoint PLUS OP4S
Threshold Settings Recommended Maximum	Class A – 3 holes per pipe @ A1 to A3 Class B – 5 holes per pipe @ B1 to B5 Class C – 8 holes per pipe @ C1 to C8 Class C Escalator Mode – 8 holes per pipe @ ESC1 to ESC8 Class C Prison Mode –	Class A – 15 holes per pipe @ Alarm Level 1%obs/m Class B – 15 holes per pipe @ Alarm Level 2%obs/m Class C – 15 holes per pipe @ Alarm Level 4%obs/m  Class A – 15 holes per pipe @ Alarm Level 1.1%obs/m Class B – 15 holes per pipe @ Alarm Level 3.2%obs/m Class C – 15 holes per pipe @ Alarm Level 11.5%obs/m
Threshold Settings Compliant Maximum EN 54-20	PR2 using Sample Head (61-988-00)	
Sampling Pipe Network	Number of inlet ports: Up to four Pipe Network Design Tool: ProFlow Maximum pipe length: Specific to individual design. To be compliant to local design codes, and verified by ProFlow.	
Airflow Monitoring	'High Airflow' and 'Low Airflow' fault monitoring	
Weight	3kg (6.6lbs)	
Dimensions (mm)	380(H) x 250(W) x 137(D)	

## Application Guide

**Class A - High Sensitivity Applications include:** - Computer rooms, Cleanrooms, Data Centres, Control Rooms, Archive Storage, EDP areas and areas where very high sensitivity is required.

**Class B - Enhanced Sensitivity Applications include:** - Historic Buildings, Museums, Hospitals, Airports, Cathedrals, Theatres, Art Galleries, Clean Warehouses, Atria, Wind Turbines, Power and Control Cabinets.

**Class C - Normal Sensitivity and Harsh Environment Applications include:** - Cold Storage Facilities, Specialist Production Facilities, Transportation Terminals, Lift Shafts, Escalators/Travelators, Prison/Police Cells and alternative applications to point type smoke detection.

## Product Codes

ProPoint PLUS OPCO - 1 Pipe	61-986-106	ProPoint PLUS OP4S - 1 Pipe	61-986-106-OP4S
ProPoint PLUS OPCO - 2 Pipe	61-986-103	ProPoint PLUS OP4S - 2 Pipe	61-986-103-OP4S
ProPoint PLUS OPCO - 3 Pipe	61-986-105	ProPoint PLUS OP4S - 3 Pipe	61-986-105-OP4S
ProPoint PLUS OPCO - 4 Pipe	61-986-104	ProPoint PLUS OP4S - 4 Pipe	61-986-104-OP4S



# **PRODUK KATALOG**



## Protec Aspirating Detection System Generic Design & Installation Guide

### **Document Revision Details**

<b>Issue</b>	<b>Modification Detail</b>	<b>Author(s)</b>	<b>Approved</b>	<b>Date</b>
0	Original Issue	MAC / AGD	CH	02/05/2018

### **GENERIC ASPIRATING SYSTEM DESIGN GUIDE**

This Design Guide has been produced by Protec Fire & Security Group to assist when designing Protec Fire & Smoke Aspirating Detection Systems for various applications.

The aim of the Design Guide is to provide a basic design concept to enable the designer to provide a considered, compliant and correctly functioning detection system using Protec Aspirating Systems solutions.

Aspirating detection systems now cover an extensive number and variety of applications. Each different aspirating system application will have many varying dimensions, airflows, background particle levels, sensitivity requirements and performance requirements, etc. Therefore, each application needs to be designed specifically for its own layout and risk.

Aspirating system applications may contain different combustible materials and therefore differing amounts and types of fire and smoke particles may be created in these areas. For this reason, it is important to select the correct detection technology for the risk.

All aspirating systems designers should be fully qualified, competent and conversant with the technical operation and differences of the various aspirating technologies and detectors. Designers should also familiarize themselves with all aspects of local applicable codes and standards.

**Please Note:**



**The information provided within this Design Guide should be used in conjunction with your Local Standards and Fire Codes. Local regional industry practices where relevant should also be observed.**

## Table of Contents

Document Revision Details.....	2
<b>GENERIC ASPIRATING SYSTEM DESIGN GUIDE.....</b>	<b>2</b>
Definition of a Protec Aspirating Detection System .....	4
Introduction to Protec Aspirating Detectors .....	5
Main Aspirating System Components .....	6
Protec Aspirating Detector Power Supply Units .....	8
Protec Aspirating System Sampling Pipe and Accessories.....	10
Typical Aspirating System Applications .....	12
Pre Design Considerations .....	13
Types' of Aspirating Detection Systems.....	15
Other Aspirating Detection System Design Considerations .....	24
Aspirating Detector Comms Networks.....	30
<b>GENERIC ASPIRATING SYSTEM INSTALLATION GUIDE .....</b>	<b>32</b>
Sampling Pipes (General).....	33
Sampling Hole Identification.....	40
Environmental & Condensation Considerations.....	41
Intumescent Fire Stop Collar.....	42
Sampling Pipe Dust Management .....	43
Extended or Capillary Sampling Pipes.....	45
Sampling Pipe 'Maintenance Test Points' Installation.....	46
References .....	47
Disclaimer .....	48

## **Definition of a Protec Aspirating Detection System**

Aspirating detectors provide an 'active' detection system that sample air from a given area or fire zone to detect the presence of combustion particles or smoke.

These combustion and/or smoke particles are transported to the detector via an integral aspirator that continuously draws air from a network of supervised sampling pipes, each containing small holes more commonly known as sampling points.

Having identified an increase in airborne combustion/smoke particle levels this information is presented as a number of staged alarms via both the detector display and outputs and is often integrated into the main building fire alarm system.

## **Introduction to aspirating 'Cloud Chamber Detection' Technology**

It is known that particles smaller than the wavelength of visible light occur spontaneously as a material is overheated and in numbers far above those present in a normal ambient environment. Cirrus Pro/ Cirrus CCD and Cirrus HYBRID detectors utilise the 'Wilson Cloud Chamber' principle to detect these sub-micron particles that are generated at the incipient and all other stages of fire.

A sample of air from the protected space is delivered to the detector via a centrifugal blower, a portion of which is diverted into a humidifier. At approximately 100% relative humidity, the sample is directed to the Cloud Chamber where, because of cooling due to rapid vacuum expansion, water condenses onto all the airborne particles within the sample.

Consequently, these thermally generated particles cause many droplets to form into a cloud, which is then detected by the measuring system of the Cloud Chamber. The density of the cloud formed is directly proportional to the number of particles present.

The result is a continuous signal that corresponds to the particle concentration. This signal is used to provide a staged alarm sequence with four alarm levels.

## **Introduction to aspirating 'Optical' & 'Optical/CO' Technology**

One alternative technology to cloud chamber based aspirating detectors is 'Optical Smoke' sensing aspirating detectors. Lasers or LED light sources can be used to identify small amounts of visible smoke particles created as material combusts. Generally speaking all optical aspirating detectors should first take the sampled air through a filter to try to remove airborne dust, as this is often the cause of unwanted alarms.

The filtered air then passes into the optical chamber in front of the light source, where reflected light from the visible smoke particles (known as light scatter) is measured by a photo collector.

The optical signal strength (amount of scattered light) is then reported as a measurement of %obs/m on the detector display.

In addition to 'Optical Smoke' sensing, some aspirating detectors also include CO (Carbon Monoxide) sensing elements. Through complex algorithms, the monitoring for CO can help avoid unwanted alarms caused by 'Optical' only detectors. It should be noted that the CO monitoring in aspirating detection systems is generally only suitable for smaller rooms due to dilution.

## **Introduction to Protec Aspirating Detectors**

### **Aspirating FIRE Detection utilising Cirrus Pro 'Cloud Chamber' Aspirating Fire Detectors**

Protec Cirrus Pro Series aspirating fire detectors utilise the 'Wilson Cloud Chamber' as its primary source of detection. This unique 'Cloud Chamber' technology enables the Cirrus Pro detectors to be one of the earliest and most versatile fire detection technologies currently available. In addition, the Cloud Chamber technology ensures that Cirrus Pro detectors provide the least possible potential for 'false alarms' caused by dust, steam, condensation, humidity, high airflow and temperature changes; which can create problems for other aspirating detector technologies. The unique cloud chamber measurement scale is in particles per cm<sup>3</sup> (PCM<sup>3</sup>). Protec Cirrus Pro 200 aspirating fire detector is fully compliant with EN54 Part 20.

### **Aspirating SMOKE Detection utilising ProPointPlus 'Optical & CO' Aspirating Smoke Detectors**

Protec ProPointPlus aspirating smoke detectors utilise 'optical' LED Scatter Chamber Detectors (SCD's) within each of the four detector sampling ports. Each SCD can be individually pre-set to Class A - high sensitivity (3 holes per pipe), Class B - enhanced sensitivity (5 holes per pipe), Class C - normal sensitivity (8 or 12 holes per pipe) and Prison Cell mode settings. The SCD smoke sensor identifies the visible smoke particles generated as material over-heats. All ProPointPlus aspirating smoke detectors are fully compliant with EN54 Part 20.

### **Aspirating FIRE & SMOKE Detection utilising Cirrus HYBRID Aspirating Fire & Smoke Detectors**

Protec Cirrus HYBRID aspirating detector contains two separate detection elements to detect two different phenomenon associated with fire (fire particles and smoke particles). The Cirrus HYBRID detector includes as its primary sensor, a 'Cloud Chamber' fire detector. This is supplemented by high sensitivity 'Optical' detectors provided within each of the four detector sampling ports.

Fire detection – The Cloud Chamber detector identifies invisible sub-micron particles generated during the combustion process when an over-heat condition occurs. The Cloud Chamber measurement scale is in particles per cm<sup>3</sup> (PCM<sup>3</sup>) and provides the 'Fire' detection element of the Cirrus HYBRID detector.

Smoke detection – Optical smoke sensors identify visible smoke particles generated as material continues to over-heat. The optical measurement scale is percent obscuration per meter (%Obs/m) and provides the 'Smoke' detection element of the Cirrus HYBRID detector.

Combined Fire and Smoke Scale – Cirrus HYBRID detectors indicate these two separate detection element scales (PCM<sup>3</sup> & %Obs/m) individually, however as its primary display these two scales are combined and integrated on a bespoke scale known as Combined Fire and Smoke (CFS). All Cirrus HYBRID aspirating fire and smoke detectors are fully compliant with EN54 Part 20.

## Main Aspirating System Components

Protec Aspirating System Detectors technical summary.

### Cirrus Pro 200 Fire Detection



Maximum area of detection allowed:	2000m <sup>2</sup> or a single zone or fire compartment
Maximum total length of sampling pipe:	Approx. 200m (subject to calculation program)
Maximum number of pipes:	4
Maximum number of sampling holes:	EN54 Class A – 36 holes/pipe Gain 9 @ 15% EN54 Class B – 36 holes/pipe Gain 8 @ 15% EN54 Class C – 36 holes/pipe Gain 7 @ 15%
	All designs subject to calculation program verification.
Sampling pipe I/D:	15mm – 25mm
Supply Voltage:	20 – 29 volts DC
Current consumption:	317mA quiescent – 357mA in alarm
Dimensions:	W – 360mm, H – 215mm, D – 144mm

For the aspirating system detector technical summary on Cirrus Pro models not detailed above please refer to Protec Fire & Protec Fire & Security Group individual product data sheets

### ProPointPlus Smoke Detection



Maximum area of detection allowed:	2000m <sup>2</sup> or a single zone or fire compartment
Maximum total length of sampling pipe:	Approx. 200m (subject to calculation program)
Maximum number of pipes:	4
Maximum number of sampling holes:	EN54 Class A – 3 holes per pipe EN54 Class B – 5 holes per pipe EN54 Class C – 8 holes per pipe
	All designs subject to calculation program verification
Sampling pipe I/D:	15mm – 25mm
Supply Voltage:	20 – 29 volts DC
Current consumption:	Fan speed dependant
Dimensions:	W – 380mm, H – 250mm, D – 137mm

### Cirrus HYBRID Fire & Smoke Detection



Maximum area of detection allowed:	2000m <sup>2</sup> or a single zone or fire compartment
Maximum total length of sampling pipe:	Approx. 260m (subject to calculation program)
Maximum number of pipes:	4
Maximum number of sampling holes:	EN54 Class A – 36 holes @ 200 CFS EN54 Class B – 44 holes @ 400 CFS EN54 Class C – 44 holes @ 600 CFS
	All designs subject to calculation program verification
Sampling pipe I/D:	15mm – 25mm
Supply Voltage:	20 – 29 volts DC
Current consumption:	Fan speed dependant
Dimensions:	W – 380mm, H – 250mm, D – 137mm

**Important Note:**

The above details reflect the general parameters where EN 54 approved products are required. All aspirating detection systems designs are subject to the local area/country design, installation and performance codes/requirements. Additionally, ALL system designs must be verified using Protec 'ProFlow' sampling pipe calculation program.

'ProFlow' sampling pipe calculations confirm acceptability of operational parameters such as type of detector, lengths of sampling pipes, quantity and diameter of sampling holes or capillary sampling points.

**Portable Aspirating Detector**




**Cirrus Pro Locator**

Maximum area of detection allowed	Hand held portable unit for localised testing
Maximum total length of sampling pipe	N/A
Maximum number of pipes	1
Maximum number of sampling holes	N/A
Sampling pipe I/D	N/A
Supply Voltage	100v – 240v 50/60Hz
Battery Life	Standard 2h 30m – Extended 3h 0m
Dimensions	W – 350mm, H – 260mm, D – 120mm

Protec Cirrus Pro Locator is a portable air sampling detector. The detector uses Cloud Chamber Detection (CCD) technology for very early warning fire detection. The unit is typically used to assist in the local identification of a potential fire source within a room, cabinet or general space. Many data centres have a Cirrus Pro Locator as supplementary equipment to the main room detection system to further aid in locating the actual origin of alarm from within electronic racks.



## Protec Aspiring Detector Power Supply Units

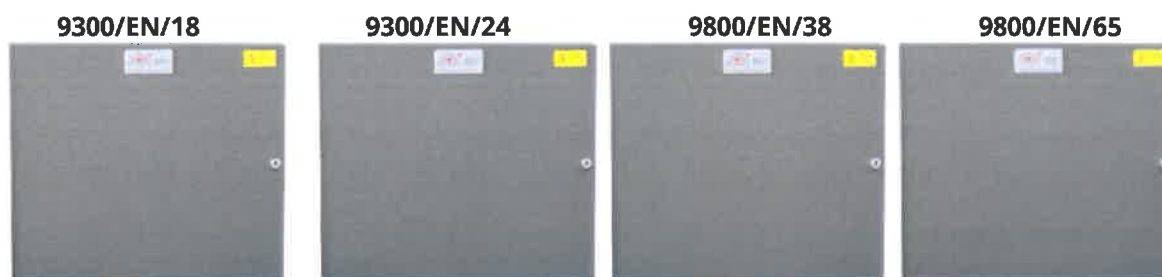

The system designers should ensure a suitable and compatible power supply is used for each aspiring detector. Protec Series 9000 3Amp & 8Amp power supplies are a self-contained supply designed to power Protec aspiring detectors and charge the associated batteries simultaneously.

The charger uses power factor correction to ensure a near unity power factor, and switch-mode technology to provide a lightweight and efficient unit.

The designer should ensure the power supply is sized correctly to suit the alarm load, the quiescent load and alarm standby periods. The following tables provides quiescent and alarm power consumption figures for Protec aspiring detectors.

### Cirrus Pro Detector Power Consumption

	STANDING	ALARM LOAD
DESCRIPTION	UNIT	UNIT
Cirrus Pro 100	263	302
Cirrus Pro 200	317	357
Cirrus Pro 200D	414	455
Cirrus Pro 200DSC	487	570
Cirrus Pro 200SC	417	521
Cirrus Pro 200+	410	430
Cirrus Pro 200D+	474	529
Cirrus Pro 200DSC+	564	662
Cirrus Pro 200SC+	417	521
Cirrus Pro X4	779	856
Cirrus Pro X4ND	699	776
Cirrus Pro RDP	80	80

### Important Note:

The designer should check the particular model of the above detectors is compliant with the relevant approvals requirements for the particular project, as not all detectors carry all global product approvals.

### ProPointPlus Detector Power Consumption

Blower Speed (%)	ProPoint Plus							
	Quiescent				Alarm			
	SCD 1x	SCD 2x	SCD 3x	SCD 4x	SCD 1x	SCD 2x	SCD 3x	SCD 4x
100	360	400	425	455	410	450	475	505
95	347	387	411	440	397	437	461	490
90	334	374	397	425	384	424	447	475
85	321	361	383	410	371	411	433	460
80	308	348	369	395	358	398	419	445
75	295	335	355	380	345	385	405	430
70	282	322	341	365	332	372	391	415
65	269	309	327	350	319	359	377	400
60	256	296	313	335	306	346	363	385
55	243	283	299	320	293	333	349	370
50	230	270	285	305	280	320	335	355
45	220	259	274	293	270	309	324	343
40	210	248	263	281	260	298	313	331
35	200	237	252	269	250	287	302	319
30	190	226	241	257	240	276	291	307
25	180	215	230	245	230	265	280	295
20	170	204	219	233	220	254	269	283
15	160	193	208	221	210	243	258	271
10	150	182	197	209	200	232	247	259
5	140	171	186	197	190	221	236	247

### Cirrus HYBRID Detector Power Consumption

Blower Speed (%)	CirrusHYBRID							
	Quiescent				Alarm			
	SCD 1x	SCD 2x	SCD 3x	SCD 4x	SCD 1x	SCD 2x	SCD 3x	SCD 4x
100	522	590	626	685	622	690	726	785
95	504	572	608	649	604	672	708	749
90	485	558	595	640	585	658	695	740
85	463	545	572	604	563	645	672	704
80	449	531	554	590	549	631	654	690
75	431	495	535	567	531	595	635	667
70	417	481	522	549	517	581	622	649
65	404	467	504	535	504	567	604	635
60	390	454	485	517	490	554	585	617
55	376	440	472	504	476	540	572	604
50	372	417	454	485	472	517	554	585
45	363	408	445	472	463	508	545	572
40	349	395	431	458	449	495	531	558
35	335	381	417	445	435	481	517	545
30	322	367	422	435	422	467	522	535
25	317	363	395	417	417	463	495	517
20	308	354	372	395	408	454	472	495
15	299	345	358	381	399	445	458	481
10	295	335	345	367	395	435	445	467
5	290	317	331	358	390	417	431	458

## Protec Aspirating System Sampling Pipe and Accessories

		
<p><b>37-550-68</b> 3 Metre Length 25mm o/d Red ABS Sampling Pipe</p>	<p><b>37-550-68-SR</b> 50m Length of 25mm o/d Flexible Red Sampling Pipe</p>	<p><b>37-552-70</b> 25mm Red ABS 90° Long Radius Bend</p>
		
<p><b>37-555-73</b> 25mm Red ABS 45 deg. Elbow</p>	<p><b>37-554-72</b> 25mm Red ABS 'Tee' Piece</p>	<p><b>37-553-71</b> 25mm Red ABS End Cap</p>
		
<p><b>37-559-77</b> 25mm Red ABS Socket Union</p>	<p><b>37-558-76</b> Red ABS Pipe Clips</p>	<p><b>37-551-69</b> 25mm Red ABS Jointing Socket</p>
		
<p><b>37-560-70</b> Conical Head Capillary Sampling point 2mtrs of 10mm sampling tube</p>	<p><b>37-561-71</b> Flush Disc Capillary Sampling point 2mtrs of 10mm sampling tube</p>	<p><b>37-562-72</b> Discrete Capillary Sampling point 2mtrs of 10mm sampling tube</p>
		
<p><b>37-563-73</b> T piece for use with 10mm Capillary Sampling tube</p>	<p><b>37-564-74</b> 30mtr coil RED 10mm Capillary Sampling Tube</p>	<p><b>37-564-74W</b> 30mtr coil OPAQUE 10mm Capillary Sampling Tube</p>

<p><b>37-566-76</b> Conical Head Capillary Sampling Point</p>	<p><b>37-567-77</b> Flush Disc Capillary Sampling Point</p>	<p><b>37-568-78</b> Discrete Capillary Sampling Point</p>
<p><b>37-585-15</b> 25mm Red ABS End Cap 'Test Point'</p>	<p><b>37-586-16</b> Flush Disc Capillary 'Test Point' c/w 2mtrs of 10mm sampling tube.</p>	<p><b>37-545-71</b> 1m x 25mm o/d Flexible Expansion Loop</p>
		<p>37-534-68 - 2.0mm Purple 37-535-69 - 2.5mm Grey 37-536-70 - 3.0mm Yellow 37-537-71 - 3.5mm Blue 37-538-72 - 4.0mm Green 37-539-73 - 4.5mm Black 37-540-74 - 5.0mm White 37-541-75 - 6.0mm Brown</p>
<p><b>37-556-74</b> S250ml Tin Solvent Cement</p>	<p><b>23-039-37</b> Sample Hole Warning Labels. Roll of 100 1no Label required per Sampling Point</p>	<p><b>Hole Identification Tags</b> (See Datasheet - MED2123)</p>
<p><b>61-986-F01</b> - 25mm In-line Pipe Filter <b>61-986-28</b> - 3 Stage Replacement Filter Mesh (See Datasheet - MED2125)</p>	<p><b>45-023-04</b> Heavy Duty Dust &amp; Humidity Filter (See Datasheet - MED2124)</p>	<p><b>45-023-07</b> - Heavy Duty Dust &amp; Humidity Filter c/w Self Drain Flexible Loop (See Datasheet - MED2124)</p>
<p><b>37-584-14-BIS</b> Condensation Trap</p>	<p><b>37-599-29</b> Flush Disc Capillary Test Point</p>	<p><b>37-590-20</b> Pipe Cutter</p>

## **Typical Aspirating System Applications**

### High Sensitivity Detection applications include:

- Clean Rooms
- Control Rooms
- Computer Rooms
- Data Storage Facilities
- Archive Storage



### General/Enhanced Sensitivity Detection applications include:

- Roof Voids
- Warehouses
- Atria
- Production Facilities
- Power & Utility Plants



### Harsh Environment applications include:

- Cold Storage Facilities
- Chilled Storage Facilities
- Food Production Facilities
- Specialist Production Areas
- Dusty Production Plants



### Special Risk applications include:

- Electrical Control Cabinets
- Prison Cells
- Power Plants
- Conveyor Systems
- Flight Simulators



### Sensitive applications include:

- Heritage Buildings
- Cathedrals
- Museums
- Art Galleries
- Cultural Centres



## **Pre Design Considerations**

### **Expectations of the completed aspirating detection system**

Prior to the detection system design and in the absence of a specification, the designer should consult with the client to confirm the expectations from the completed aspirating detection system. These consultations should include such things as the 'type' of detection system to be installed, the compliance with applicable local area codes and standards, the 'realistic' sensitivity of the detector for the given application and a possible and suitable performance test for the completed installation, if required.

### **Detector Sensitivity**

The sensitivity of the required detection system is dependent upon a number of issues including the application of the detection system, the 'type' of aspirating detection system employed, the ambient background particle levels, local area codes and performance test requirements.

Aspirating detectors have a large sensitivity range. This enables the detectors to be installed in applications as diverse as a 'Cleanroom' requiring the very highest sensitivity available through to a 'polluted' warehouse/production area, where detector sensitivity is often determined or restricted by the background environmental operating conditions.

By utilising the range of the detector sensitivity, it is possible that from a single aspirating detector up to four alarms can be generated at different points along the fire growth curve as detailed in the example below.

### **Example 1: Computer Room Installation using a 'cloud chamber' based aspirating detector**

- Pre-alarm condition - May be given when the detector is operating at a very high sensitivity level. This condition would most likely initiate a visual check only of the protected space. It should be noted that there may not be any visible smoke present at this time. (0% obs/ft.)
  
- Fire 1 condition - May be given when the fire condition is continuing to develop. This alarm level may 'shut-down' any forced ventilation to enable any point/spot detectors to be more efficient.
  
- Fire 2 condition - May be given when the fire condition is continuing to further develop. This alarm could provide a signal to 'evacuate' the building to protect any personnel that may be affected by the alarm condition.
  
- Fire 3 condition - May be given when the fire condition is continuing to further develop. This alarm level could provide a signal to a 'fire suppression' system to suppress/extinguish the fire condition.

## Example 2: Warehouse Installation using a 'cloud chamber' based aspirating detector

- Pre-alarm condition - Local area visual investigation, area may contain invisible fire particles and visible smoke particles.
- Fire 1 condition - Evacuate signal sent to main building fire alarm system – possible similar cause and effect outputs to point type smoke detector installations.
- Fire 2 condition - Not Used
- Fire 3 condition - Not Used

### **Background Particle Levels**

The actual sensitivity setting of the detector for each specific application can be affected by the ambient background particle level in the area of detection. This ambient particle level may be influenced by many sources including; the height of the area, the proximity to outside air, any production or manufacturing processes that may be carried out within the environment and the influence of forced air ventilation or air penetrating from adjoining areas.

It is important to remember this ambient background particle level may not be consistent throughout the period of a day, week other time span. With this in mind, the sensitivity of some aspirating detectors can be configured to suit the variable background levels in a number of ways; including different time zone settings typically described as 'day/night' settings and by each day of the week to allow for differences between working days and none working days.

### **Detector Settings often referred to as 'Detector Class'**

Aspirating Detection Systems are generally designed in compliance with standards such as EN54-20:2006 Section 7 and in such cases are classified as a Class A, Class B or Class C Systems. This classification assumes that the final operational environment is suitable for this design and proposed detector sensitivity, both at commissioning stage and more importantly, when the building becomes fully operational. Where the client's environment cannot provide a background level that allows the correct sensitivity, the application may be considered to be of an 'Undefined Detector Sensitivity' and sit outside Class A, B or C.

#### Class A Detection System

*Definition:* - Aspirating smoke detector providing very high sensitivity. These systems are often employed in areas so that evasive measures can be initiated before any significant damage is incurred to areas containing mission critical or high value artefacts or operations.

#### Class B Detection System

*Definition:* - Aspirating smoke detector providing enhanced sensitivity. These systems are often employed in areas where fire and smoke particles are difficult to detect. This would include areas where there is dilution from high airflow movements or where there are high ceiling spaces.

#### Class C Detection System

*Definition:* - Aspirating smoke detector providing normal sensitivity. These systems are often employed as an alternative to point type smoke detectors or beam detectors, for reasons such as; building deflection or where perhaps servicing is made easier using aspirating system pipe installations.

### Undefined Detector Sensitivity

*Definition:-* Aspirating smoke detector providing sensitivity applicable to the operational environment.

Aspirating detection systems are sometimes employed in difficult or harsh environments applications. This is usually after consideration is given to other detection technologies such as point type heat and smoke detectors, beam detectors, flame detectors or linear heat detection etc. When aspirating detection systems are employed in these difficult applications, it is important to consider the effectiveness of the detector sensitivity, as this is usually determined by the varying background ambient environment.

The amount of ambient dust, humidity, temperature, steam, vehicle emissions and other pollutants will all influence the operational sensitivity of the aspirating detector. Therefore, the detector sensitivity is essentially configured to accommodate these ambient background conditions within the End Users operational environment and as importantly, to avoid where possible unwanted alarms from non fire events.

To allow the correct sensitivity setting of these detection systems, it is important to introduce an extended 'soak test period', where the background pollutant variations can be determined. Having logged this information for an appropriate time period, the alarm thresholds can then be configured to avoid unwanted alarms.

Having established the ambient background environment and detector alarm thresholds, a suitable 'performance test' is recommended. Any tests should be agreed by all concerned parties and appropriate health and safety procedures should be adhered to. See Note below on 'Requirement for Aspirating Detection System Function and Performance Testing.'

## **'Types' of Aspirating Detection Systems**

It is generally accepted that there are five concepts of Aspirating Detection System design.

### Primary Detection Sampling System

*Definition:-* A system utilising the airflow created by the air conditioning and ventilation system to carry the sampled air to the sampling points.

### Secondary Detection Sampling System

*Definition:-* A system where the air sampling points are sited and spaced as if they are point type smoke detectors.

### Localised Detection Sampling System

*Definition:-* A system where the air sampling points are arranged and spaced to provide monitoring of specific pieces of equipment.

### Duct Detection Sampling System

*Definition:-* A system where the air sampling is provided within the ducting of a ventilation system.

### In-Cabinet Detection Sampling System

*Definition:-* A system where the air sampling is provided either directly inside or adjacent to a specific piece of electronic hardware or control equipment.




### **Primary Detection Sampling Systems**

Primary Detection Sampling Systems are designed to monitor the airflow movement within a room by strategically positioning the sampling pipe directly in the airflow. This type of detection is usually supplementary to other forms of detection, as it would have limited detection response when the forced airflow is not operational.

Due to the cumulative effect (air with combustion particles entering more than one sampling point), the sensitivity of such a system when monitoring a single point of extract or supply, may be directly related as equal to the sensitivity of a central detector. Consultation should be sought with Protec Fire & Security Group or its nominated representative where detection is taken from multiple supply and extract points on the same detector.

Aspirating detectors can operate at very sensitive levels when used as a means of Primary Detection and as such, are often used to 'shut-down' mechanical ventilation systems to enable 'point type' detectors to operate more efficiently.

Note: Primary detection is usually regarded as supplementary to other forms of detection due to its limited response capability once the air movement ceases. With this in mind, the aspirating system designer should confirm with local area/country design codes to identify other additional relevant forms of detection within the protected areas.

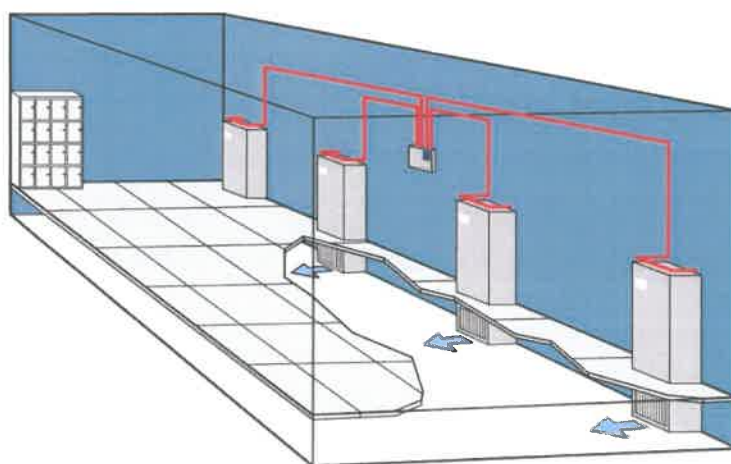

Primary Detection Example  
(All sampling points located directly in the airflow of the room at the return air grille of each handling unit)

### Secondary Detection Sampling Systems


Secondary Sampling Systems are designed so that the air sampling points are sited and spaced as if they are 'point type' smoke detectors in line with local standards and codes.

This design concept may offer an extremely good alternative to 'point type' detectors or 'beam' detectors when installed in high applications. For these high level applications, it may be necessary to install some vertical or multi-level sampling points as some smouldering fires produce little heat energy to carry particles to the high level detection points.


Care should be taken with this design option to ensure that ceiling 'apex' areas, voids and compartments are covered correctly.

Where access for maintenance of 'point type' detectors or 'beam' detectors may be either difficult or expensive, Secondary Sampling Systems can provide a logical and inexpensive design option. It is recommended that dedicated sampling pipe 'test points' are installed in accessible locations. This will enable the integrity of the entire sampling pipe array, to be confirmed during maintenance visits. Note: In addition to test point testing, the airflow values of each sampling pipe also require verification with the previous commissioning/service visit values.

The design of a secondary aspirating detection system could comply with local country codes and standards, however, the performance with regards to airflow dynamics, may be improved with additional sampling holes drilled into the sampling pipe. This would be at virtually no additional cost to the installation. Additionally, on some smaller installations, extra sampling holes can increase the air flow in sampling pipes, which can allow pipes to be less susceptible to room airflow pressure changes.

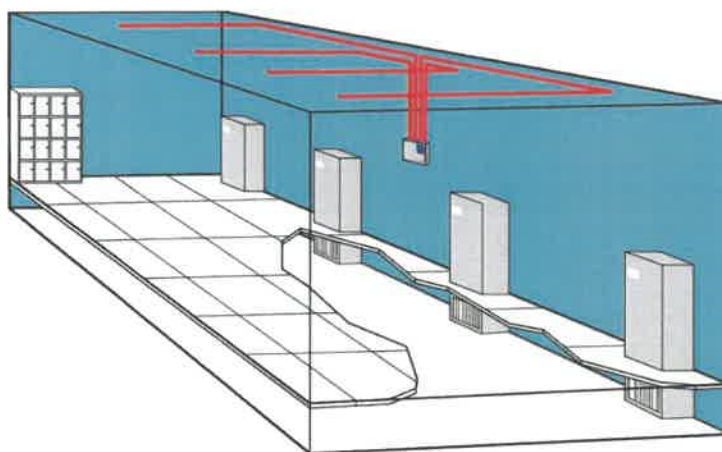

Secondary Detection Example  
(All sampling points located in the position of 'point type' smoke detectors)

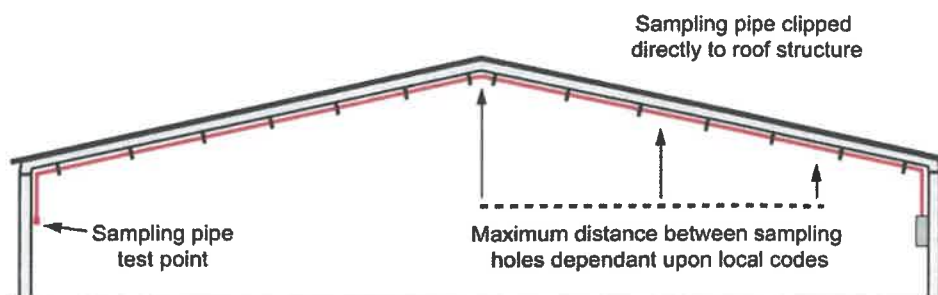

Secondary Detection Example  
(All sampling points located in the position of 'point type' smoke detectors)


### **Localised Detection Sampling Systems**

For localised sampling, the pipe work and sampling points are arranged to monitor specific pieces of equipment in an open area.


This method of detection is usually established following some type of test simulation to best recreate, where possible, the actual application. The sensitivity of such a system is generally dependent upon the application and environment of the specific piece of equipment.

Consideration must also be given by the end user to ensure that any future changes to the equipment do not have a detrimental effect on the installed detection system.

#### Localised Detection Example - Data Storage Carousel

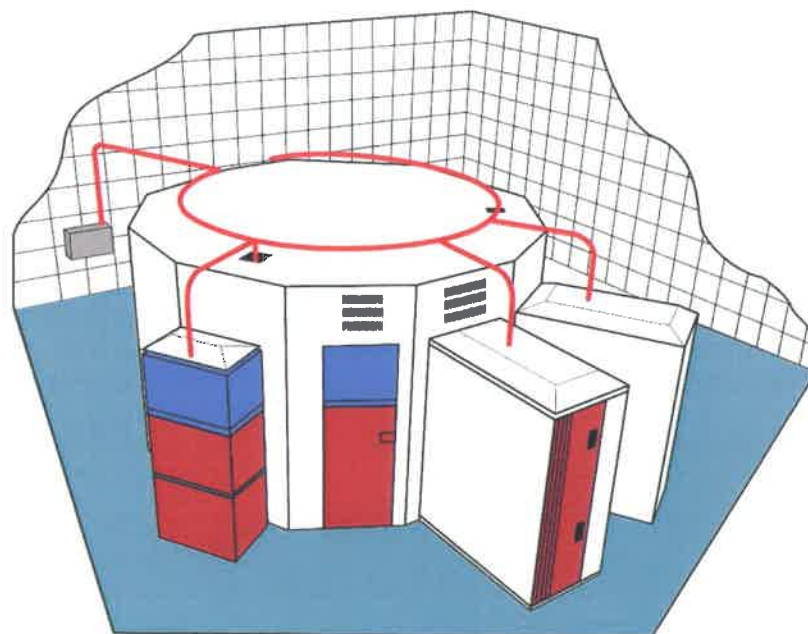

#### Localised Detection Example - MRI Scanner

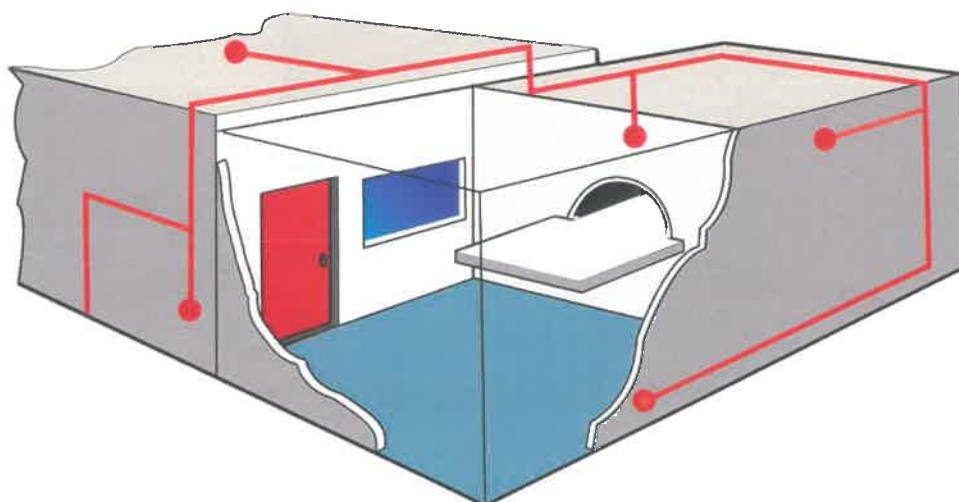

## Duct Detection Sampling Systems

Aspirating Detectors may be used for duct sampling, dependent upon the risk and application.

Duct detection systems usually comprise of the aspirating detector mounted locally to the protected duct. An 'air inlet' sampling pipe probe is installed into the ducting to carry the sampled air to the detector and an 'exhaust' sampling pipe probe is installed into the ducting to return the sampled air to the duct.

It is strongly recommended that Duct Sampling Systems are installed in straight lengths of ducting at a distance of 6 times the diameter of the duct downstream of any bends, nozzles, tee's or branches, etc. For this reason, Duct Sampling is not recommended for flexible ducts due to the turbulence of air usually found within this type of ducting.

For small ducts up to 1m wide, the 'air inlet' sampling pipe probe is mounted in the centre of the duct with sampling holes spaced approximately 200mm apart. The 'exhaust' sampling pipe probe should be mounted a minimum of 500mm downstream of the 'air inlet' probe and at a quarter of the height of the duct from the top or bottom of the duct, with a minimum of 4 holes mainly concentrated towards the middle of the duct.


For larger ducts 1m - 2 m wide, it is recommended that the 'air inlet' sampling pipe probe be branched outside the duct to create two individual probes. These should be mounted proportionally within the height of the duct, with the 'exhaust' sampling pipe probe mounted centrally within the duct. Again, a minimum of 4 sampling holes concentrated mainly towards the middle of the duct should be installed.

The quantities and diameter of all sampling holes should be confirmed utilising the Protec 'Pro Flow' sampling pipe calculation program.

Sampling from multiple ducts is not recommended.

Sampling from ducting and ambient environments is not recommended on the same detector.

The FIA Code of Practice Issue 3 February 2012 offers some useful guidance on Duct Sampling or alternatively for further information on this specialist type of aspirating detection system design please contact Protec Fire & Security Group.

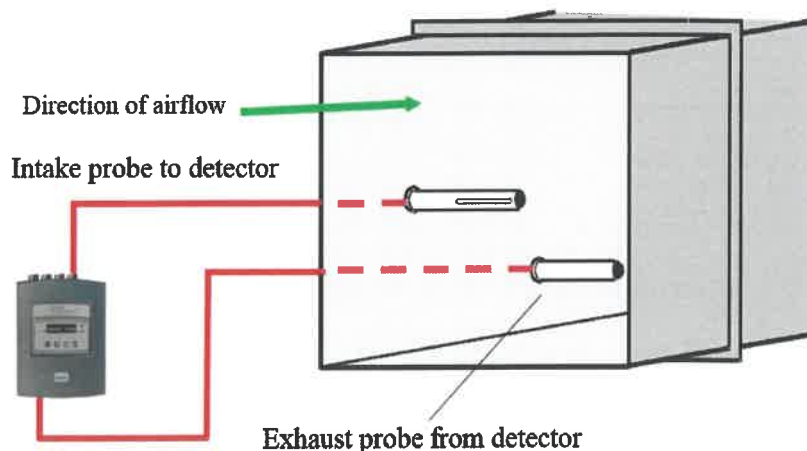

### **In-Cabinet Detection Sampling Systems**

In-Cabinet Detection sampling is where the air sampling is provided either directly inside or adjacent to electrical cabinets, racks, consoles, switchgear, cable trays or any other electrical equipment, electronic hardware or control equipment.

This monitoring technique may be used where the protection of specific pieces of equipment is critical to the continued operation of communications, control or production processes.

In-cabinet detection systems should not be expected to provide detection outside of the protected cabinet/equipment. Room detection should be provided by other dedicated aspirating detectors.

The designer should consider the quantity of cabinets protected by a single detector, as in an alarm condition the inspection of many cabinets may be time consuming. Consideration must also be given by the end user to ensure that any future changes to the equipment function or layout do not have a detrimental effect on the detection system.


ABS sampling pipe is non-conducting and therefore has no effect on sensitive electronic components. Likewise, unwanted alarms should not be experienced from electromagnetic interference.

### **Above Cabinet Sampling Pipes**

Sampling pipes are placed directly above the equipment, in the path of the airflow generated by the forced or natural ventilation.

Sampling pipes should be located in the centre of the exhaust air stream or directly above the equipment being protected. To enable optimum performance these sampling holes may need to be placed off centre of the airflow. If there are multiple equipment exhausts then sampling points must be located over each opening.


Where cabinet exhaust vents are large, it may be necessary to use two or more sampling pipes to adequately detect all potential incidents. When possible, a series of tests should be performed to verify the efficiency of the installation. If differential pressures create airflow faults, it may be a requirement to modify the aspirating detector exhaust to rectify this.

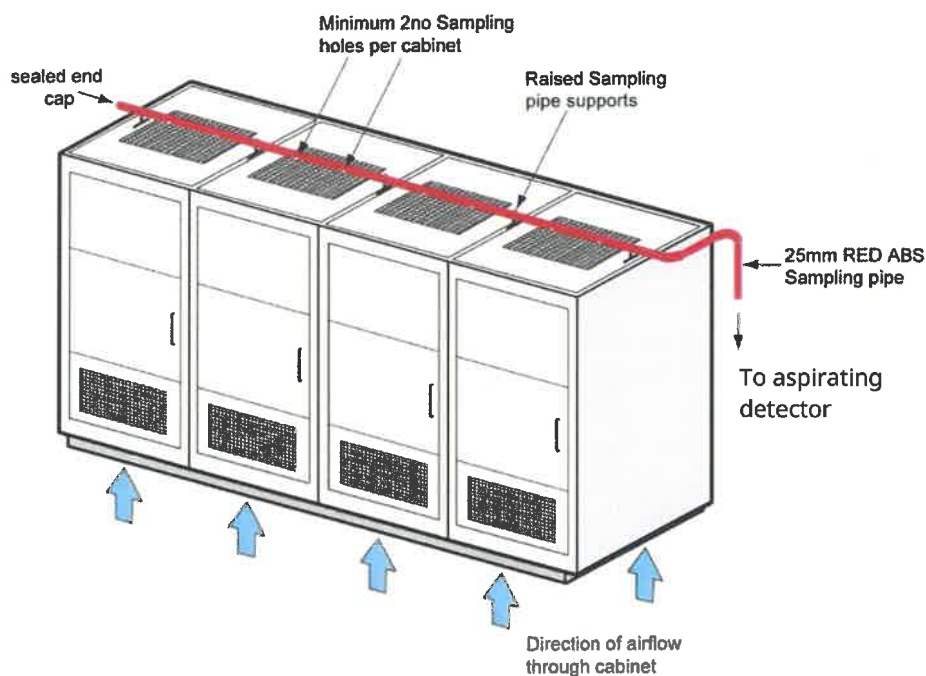

### **In-Cabinet Sampling Pipes**

This method of detection is often achieved using standard sampling pipe or 'Capillary Sampling Points' installed directly inside 'locked' electrical cabinets. If detection is provided by utilising forced airflow through a cabinet, then consideration should be given to the overall system detection capabilities should the forced airflow fail or be switched off.

For safety reasons, it is recommended that dedicated sampling pipe 'test points' are installed in 'safe' locations. This enables the integrity of the entire sampling pipe array to be confirmed during maintenance visits, without the need to power down electrical cabinets to gain access to the sampling points. To enable optimum performance, sampling holes may need to be placed off centre of the airflow. If differential pressures create airflow faults, it may be a requirement to modify the aspirating detector exhaust to rectify this.

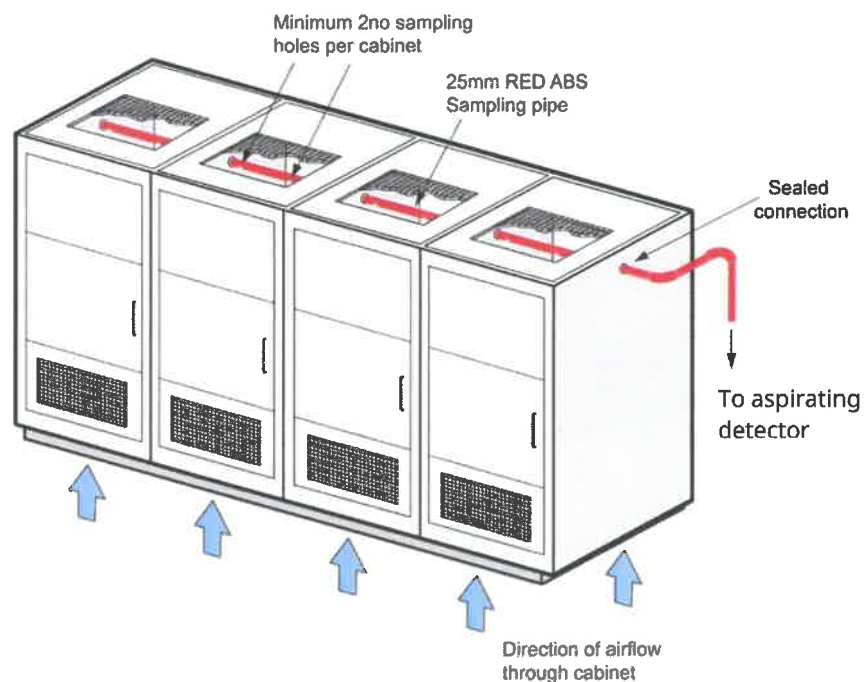


### **Alternative In-Cabinet Sampling Pipes Utilising Capillary Sampling Points**

A more aesthetically pleasing installation may utilise the under floor void area for the main trunk pipe, with small bore capillaries installed to the optimum detection position.

The capillary sampling pipe should be securely fixed inside the cabinets to prevent interference with the normal operation of the cabinet.

To enable optimum performance, sampling holes may need to be placed off centre of the airflow. Additionally, it may be a requirement to take the aspirating detector exhaust into the protected cabinets. If differential pressures create airflow faults, it may be a requirement to modify the aspirating detector exhaust to rectify this.

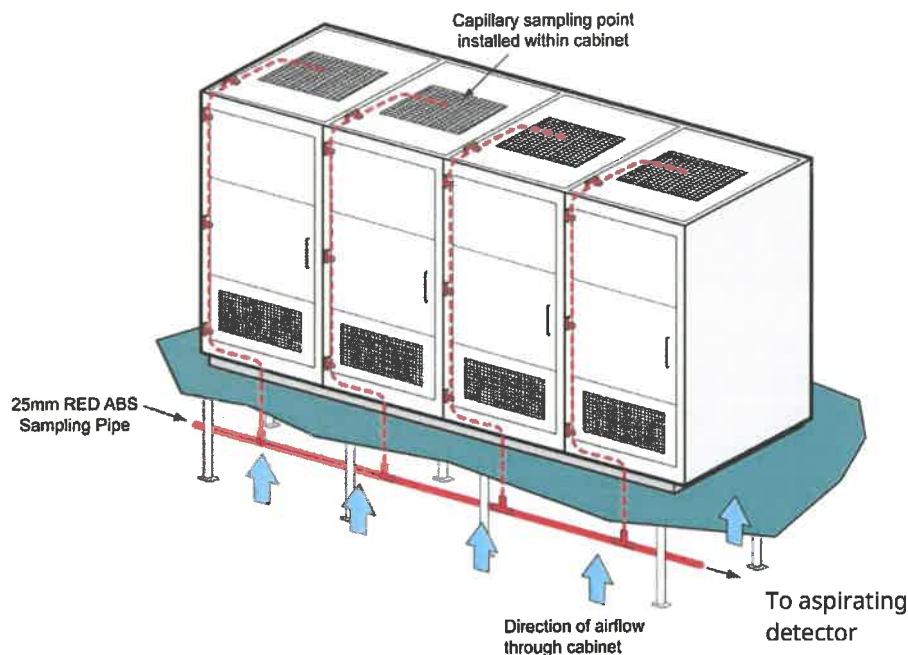



## **Other Aspirating Detection System Design Considerations**

### **Stratification Effect on Aspirating System Designs**

Stratification can occur when air containing smoke particles or gaseous combustion products is heated by smouldering or burning material. Whilst becoming less dense than the surrounding cooler air, it rises until it reaches a level at which there is no longer a difference in temperature between it and the surrounding air. The smoke plume, as it rises, encounters colder air from above which absorbs heat and slows the upward movement of the smoke.

As this stratified gas layer moves away from the fire, cooling and dilution will eventually produce a well-mixed flow of combustion products.

Stratification can also occur during hot days when the sun has heated the roof structure of a building to a high temperature producing a much hotter air layer just below the roof. A small fire starting at ground level may not have the thermal energy to push the smoke particles through the higher temperature air barrier. This would result in the smoke not reaching the detection points on the roof level until the fire is considerably larger.

Testing has indicated that a 'cloud chamber' based detection system such as Protec Cirrus HYBRID or Cirrus CCD are slightly less susceptible to stratification when compared to 'optical' only aspirating detectors, however this phenomenon should not be ignored and must still be a design consideration.

One option when stratification is considered to be relevant would be to allow sampling holes to be dropped from the main ceiling detection level to a height where they would not be affected by the stratification (these are known as extended sampling points). An alternative option would be to install one or more (as required) vertical sampling pipes, in addition to the main ceiling detection sampling points.

### **Dilution Effect on Aspirating System Designs**

Dilution can affect aspirating detection systems and therefore this should be considered at design stage. The amount of dilution is affected by the detector sensitivity and the number of sampling holes within the protected area.

When combustion/smoke particles are only drawn through a single sampling hole, these particles are diluted when they reach the detector by the clean air drawn through the remaining holes. Given that this is the case, the more sampling holes used on the design the greater the potential for dilution.

Aspirating systems should be designed (and proven by a sampling pipe calculation program) to ensure a similar amount of airflow is drawn through each sampling hole. Additionally, verification testing of detector response and transport time is required for each sampling hole.

Where Protec EN54 part 20 approved aspirating detectors are used the restrictions on the number of sampling holes has been determined as an integral part of the approval process. The following should be applied by all designers to these designs.

#### Cirrus Pro aspirating system designs

EN54 Class A – maximum 36 holes/pipe Gain 9 @ 15%

EN54 Class B – maximum 36 holes/pipe Gain 8 @ 15%

EN54 Class C – maximum 36 holes/pipe Gain 7 @ 15%

#### ProPointPlus aspirating system designs

EN54 Class A – maximum 3 holes per pipe

EN54 Class B – maximum 5 holes per pipe

EN54 Class C – maximum 8 holes per pipe

#### Cirrus HYBRID aspirating system designs

##### Non- scanning detectors

EN54 Class A – 36 holes @ 200 CFS

EN54 Class B – 44 holes @ 400 CFS

EN54 Class C – 44 holes @ 600 CFS

#### Cirrus HYBRID aspirating system designs

##### Scanning detectors

EN54 Class A – 36 holes @ 400 CFS

EN54 Class B – 44 holes @ 400 CFS

EN54 Class C – 44 holes @ 600 CFS

For other design standards and product approvals the designer should seek the technical requirements of that standard.

#### **Pressure Differentials between Rooms**

The aspirating system designer should consider the location of the aspirating detector for a number of reasons including (but not limited to) accessibility, security, temperature and any other environmental conditions.

However, one consideration often overlooked is the location of the aspirating detector when related to the protected space. This can be very important to the fundamental operation of the detector, especially if there are air pressure differentials between these two areas. These are often (but not always), rooms that contain some sort of forced air movement. Typical examples of these applications can include; computer suites, cold storage facilities, chilled storage, duct sampling systems and many others, where the detector is located in adjoining rooms/areas to the protected space.

The most common way to avoid this potential problem is to ensure the aspirating detector exhaust is returned to the same air space protected by the sampling pipes, thereby equalising any pressure differential.

#### **Venturi Effect around Sampling Holes**

The aspirating system designer should consider any natural or forced air movement likely to be prevalent around the areas where the sampling holes are located. One effect of excessive natural or forced air movement could be to create areas where a Venturi Effect would reduce or possibly prevent, air entering the sampling points thus restricting the efficiency of one or more sampling holes.

Some applications including duct detection, in-cabinet detection where forced or natural airflows are expected, cold storage, chill storage and cooler storage facilities are particularly vulnerable to this potential problem.

## **Transport Time Requirements for Aspirating System Designs**

### **Transport Time Definition:**

*Definition:* The time for aerosols to transfer from a sampling point to the smoke sensing element.

### **Maximum Transport Time**

*Definition:* The maximum time in the aspirating detection system for aerosols to transfer from the furthest sampling point to the smoke sensing element.

Maximum transport time requirements are given below for Class A, Class B and Class C designs with reference to FIA Code of Practice for Design, Installation, Commissioning and Maintenance of Aspirating Smoke Detector (ASD) Systems Issue 3 February 2012.

Class A designs – maximum transport time = 60 seconds

Class B designs – maximum transport time = 120 seconds

Class C designs – maximum transport time = 120 seconds

## **Maintenance Test Points**

*Definition:* A test point, provided beyond the last sampling point, to test the integrity of the pipe network. Such a test point is closed in normal operation and is not subject to the maximum transport time.

As 'Maintenance Test Points' do not form part of the sampling pipe detection system, the transport time taken from the 'Test Point' to the detector is not restricted. However, the transport time taken from each 'test point' should be recorded and repeated on each visit with any changes in time investigated. Additionally, when maintenance test points are used it is a requirement that the airflow value readings be compared and confirmed with previous airflow value readings to ensure they remain the same.

For other design standards and product approvals the designer should seek the technical requirements of that standard.

## **Design Verification**

It is a requirement that upon completion of every aspirating system design confirmation of all the design parameters is verified by the use of a compatible sampling pipe design calculation programme.

This programme should confirm the following:

- The model number, type and fan speed of the selected detector
- The relevant approvals of the selected detector
- The minimum and maximum pipe lengths and number of sampling holes proposed
- The airflow rates, parameters and pressures at each part of the installation
- The time taken from all the sampling holes to the detector (transport time).

This programme will confirm the sampling hole dimensions and will indicate if there are any errors with the overall design.

### **Requirement for 'Commissioning/Function Testing'**

Any commissioning or functionality testing required by any design code or local country legislation, should be carried out when the installation works are fully electrically and mechanically complete. Testing should include the individual testing/proving of ALL sampling holes of the aspirating detection system, using only the correct test material and in conjunction with the relevant Protec product manuals. The results of these tests should be recorded on the appropriate commissioning documentation.

The designer should therefore confirm at design stage the possible requirements of any functionality testing with regards to any cause and effects of the installed aspirating detection system, should this be required.

### **Requirement for 'Performance Testing'**

#### **Prescriptive or Performance Based Designs**

Typically, 'point type' smoke detection systems usually only require compliance to an area of coverage per device. Aspirating detection systems however should be designed to achieve an acceptable level of fire detection for the protected area and to take into consideration other aspects such as ventilation and forced or natural extraction points. Therefore, the designer should, where possible, request information or acquaint themselves with any aspects of the proposed area to be protected, that could be affected by these air movement and any other influences.

Prescriptive or Performance based designs are dependent upon the classification of the proposed aspirating system employed. Generally, there is only one situation where a performance test can be omitted and that is when the approved aspirating detector is deployed (and is fully compliant with the specific requirements of the product approval), with sampling hole spacings that fall within the full requirements of the relative prescriptive code. In all other situations, it is recommended that a suitable performance test is specified and carried out during commissioning to verify the system.

**Note:** Performance test should only be carried out when the building is in its final environmental and operational state, with any air conditioning, production machinery, environmental conditions etc. active.

The designer should therefore confirm with the client at design stage the most suitable 'performance test' for the installed aspirating detection system should this be required.

### **Typical Rules Regarding Sampling Pipe Types and Installation**

Please refer to the Generic Installation Guide later in this manual.

### **Sampling Pipe Expansion and Contraction**

Please refer to the Generic Installation Guide later in this manual.

### **Sampling Pipe Clips, Fixings and Labelling**

Please refer to the Generic Installation Guide later in this manual.

### **Environmental Considerations – Condensation, Dust, Temperature etc..**

Please refer to the Generic Installation Guide later in this manual.

### **Sampling Pipe 'Maintenance Test Points' Installation**

Please refer to the Generic Installation Guide later in this manual.

### **Sampling Pipe Dust Management**

Please refer to the Generic Installation Guide later in this manual.

### **Extended or Capillary Sampling Pipe**

Please refer to the Generic Installation Guide later in this manual.

## Sampling Pipe Calculation Program (ProFlow)

The design of any Aspirating Detection System should be confirmed by producing a sampling pipe calculation.


'ProFlow 2 and ProFlow 3D' is a 'Windows' based software program that allows the designer to enter the site specific information and then to automatically check a range of possible aspirating detector, sampling pipe sizes, sampling pipe lengths, quantity and diameter of sample holes or capillary sampling point configurations.

These programs can allow many design configurations to be evaluated and helps the designer to choose the most suitable layout for each individual application.

Some software 'default' parameters may be changed to allow compliance with local codes or project specific problems.

The completed calculations may be saved and should be presented to the system installer to ensure the proposed design is followed accurately. The installer should advise the designer if any part of the works cannot be completed in line with the original proposal, whereupon a revised sampling pipe design and calculation should be completed to ensure correct operation.

In addition, the calculation information should also be presented to the commissioning or test engineer to allow the detector to be configured correctly. The engineer can then confirm, through actual sampling pipe and sampling hole testing, the correct aspirating detection system operation, in line with the design proposals.

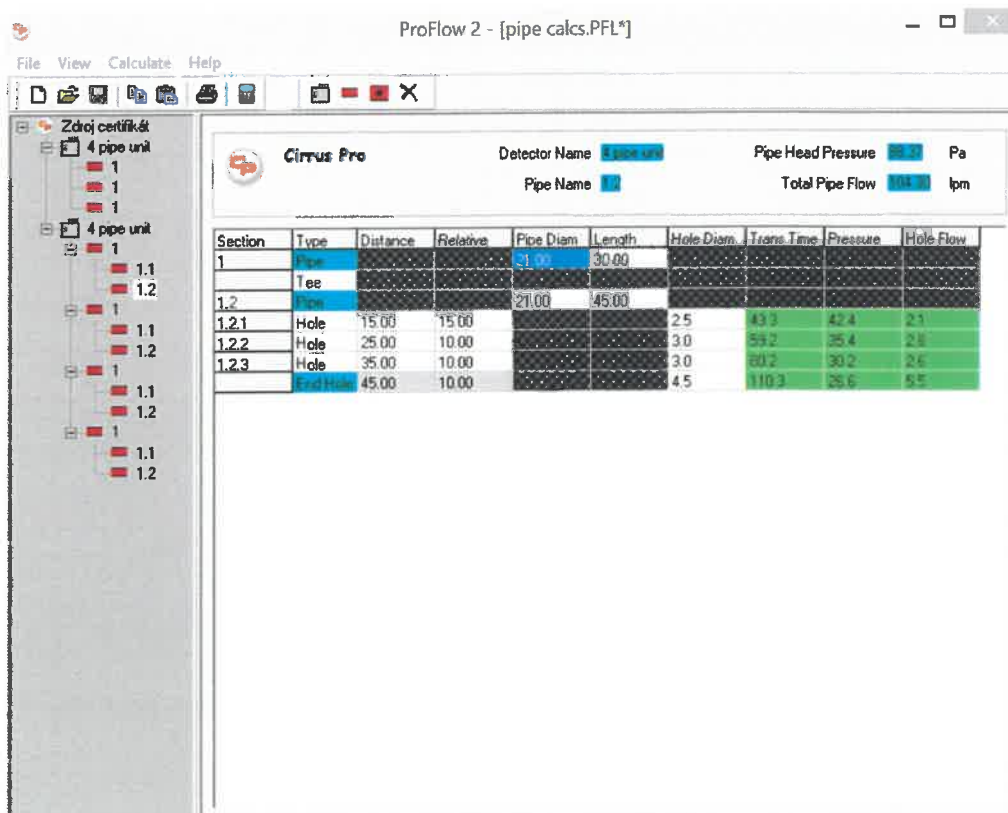

The screenshot shows the ProFlow 2 software interface. The title bar reads "ProFlow 2 - [pipe calcs.PFL\*]". The menu bar includes "File", "View", "Calculate", and "Help". The toolbar contains various icons for file operations and calculations. On the left, a tree view shows a hierarchical structure of "4 pipe unit" components, with sub-items labeled "1", "1.1", and "1.2". The main window displays the "Cirrus Pro" detector configuration. The "Detector Name" is set to "Cirrus Pro", "Pipe Name" is empty, "Pipe Head Pressure" is "25.2 Pa", and "Total Pipe Flow" is "101.3 lpm". Below this, a table lists the calculated sections of the sampling pipe system.


Section	Type	Distance	Relative	Pipe Diam	Length	Hole Diam	Trans Time	Pressure	Hole Flow
1	Pipe			1.00	30.00				
	Tee								
1.2	Pipe			21.00	45.00				
1.2.1	Hole	15.00	15.00			2.5	43.3	42.4	2.1
1.2.2	Hole	25.00	10.00			3.0	53.2	35.4	2.3
1.2.3	Hole	35.00	10.00			3.0	60.2	30.2	2.6
	End Hole	45.00	10.00			4.5	110.3	25.6	5.5

## **Aspirating Detector Comms Networks**

### Cirrus Pro RS485 Networks

Cirrus Pro detectors may be networked together to form an information highway between all connected detectors and displays. The RS485 network may consist of up to a maximum of 32 Cirrus Pro detectors and up to 32 Cirrus Pro displays. Each network device (detector or display) is given a network number for individual identification on the network.


If a Cirrus Pro detector identifies either an 'alarm' or 'fault' condition, this information is given on all the required displays. A 'network fault' is provided at each display if a network connected device has lost communications with the main network.

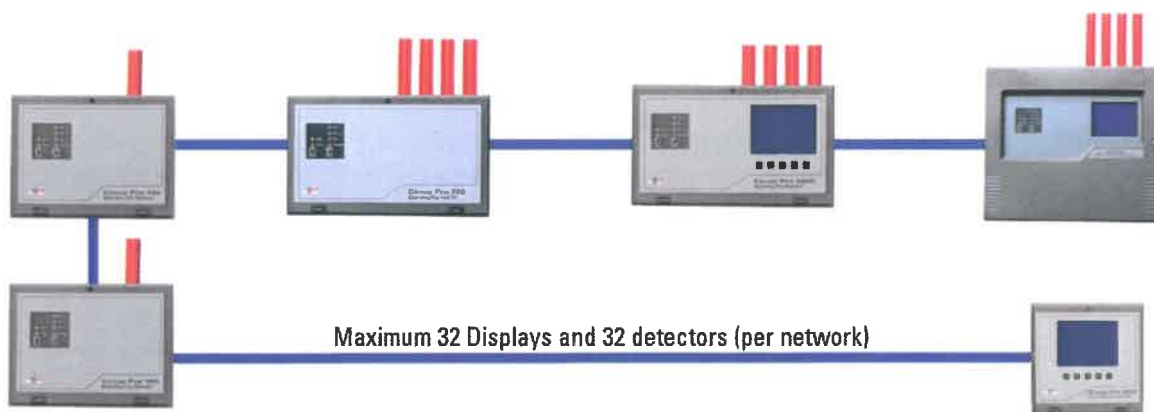

### Cirrus HYBRID and ProPointPlus RS485 Networks


Cirrus HYBRID & ProPointPlus detectors may be networked together to form an information highway between all connected detectors. The RS485 network may consist of up to a maximum of 32 Cirrus HYBRID/PPP detectors. Each network device (detector or display) is given a network number for individual identification on the network.

If a network detector produces either an 'alarm' or 'fault' condition, this information can be viewed from the Protec Asp. RDP. A 'network fault' is produced at each display if a network connected device has lost communications with the main network. Each network must contain a Protec Asp. RDP.

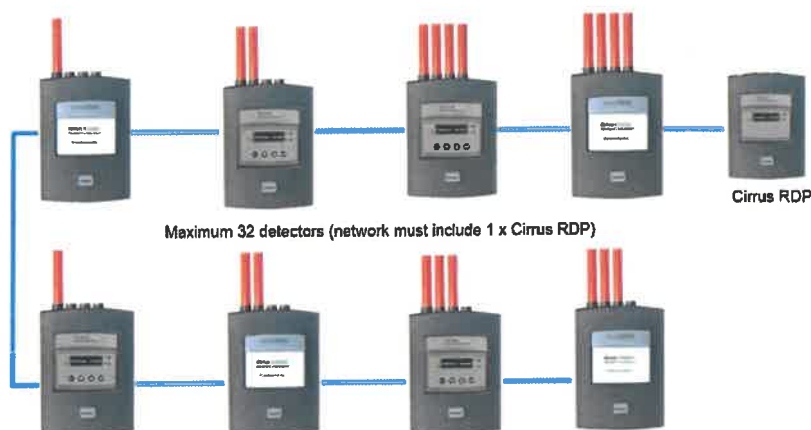

### TCP/IP Networks

Cirrus HYBRID and ProPointPlus aspirating detectors can be incorporated onto dedicated aspirating system IP networks or general building IP networks. Network cabling for this type of installation utilises Cat 5 cable.

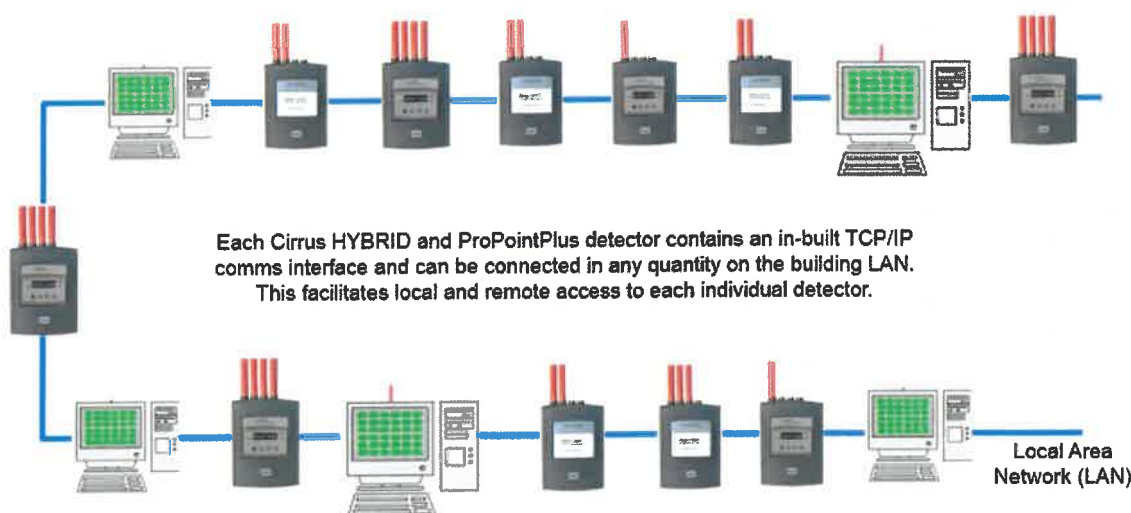

Please note that Cirrus Pro RS485 networks are NOT compatible with Cirrus HYBRID and ProPointPlus RS485 networks.


For further information on networking of any Protec aspirating detectors please refer directly to Protec Fire & Security Group.



## **GENERIC ASPIRATING SYSTEM INSTALLATION GUIDE**

Following on from the generic application design guides, detailed previously in this document, there are a number of generic installation procedures and techniques that should be adhered to, in order to provide a high quality and fit for purpose aspirating detection system.

Many of these are detailed in the following pages and all parties including the specifiers, designers, installers, commissioning and future servicing engineers, should all be fully aware of these.

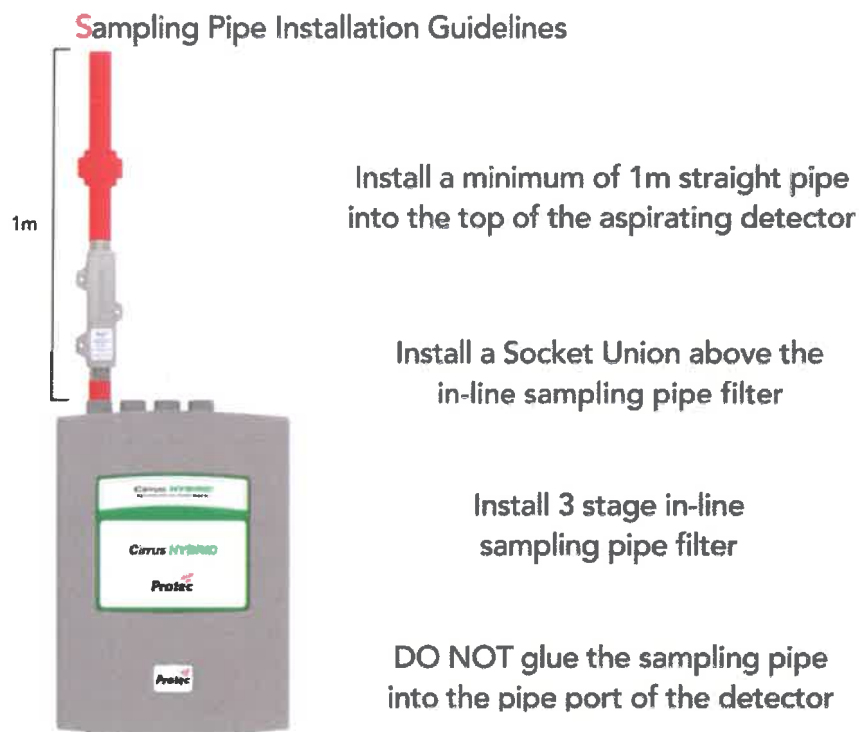

All Protec aspirating systems should be fitted with in-line sampling pipe filters. Ideally, these should be installed in a position above the aspirating detector. If this is not possible, the filter should be installed at a serviceable position between the aspirating detector and the first sampling hole. The exact type of filter (standard or heavy duty) should suit the actual application.

Protec would recommend the installation of a sampling pipe socket union above the in-line pipe filter to allow any filter removal if necessary without disruption to the main sampling pipe installation.

Ideally a 1m length of vertical sampling pipe should be installed above the aspirating detector to allow linear airflow directly into the aspirating detector.

## **Sampling Pipes (General)**

All sampling pipe should be smooth bore, nominal diameter, airtight and able to withstand the required nominal pressure. Recommended pipe materials include uPVC, ABS, Copper and Galvanised Steel. The use of other sampling pipe material, particularly flexible type pipes should be confirmed with Protec Fire & Security Group or its nominated representative prior to installation.

The selected sampling pipe should be suitable for the environment in which it is to be installed. As an example, uPVC sampling pipe and accessories should not be installed in temperatures below 5°C. Care should be taken in the selection of sampling pipe with regards to the sampling pipe bore diameters. All sampling pipe installations shall be confirmed as suitable using the 'ProFlow' sampling pipe calculation program.

For most standard applications Protec recommend industry standard ABS sampling pipe.

### **General Information**

ABS (Acrylonitrile Butadiene Styrene) is a homogenous material with good chemical resistance and high impact strength. Other advantageous features are its suitability for use at low temperatures (-40°C) and its ease of jointing.

### **Standards**

Protec supplied Aspirating Pipe and Fittings are produced under a strict quality control system approved to EN ISO 9001. Protec supplied Aspirating Products have been Tested by LPCB to EN 54-20 Clause 5.7, EN 61386-1 Class 1131. LPCB Test Report No- TE250773

Individual products are in accordance with the appropriate British Standards.

Fittings (inch) BS 5391 Part 1, EN 1452 Part 3, EN 54-20 Clause 5.7, EN 61386-1 Class 1131

Fittings (Metric) Din 8063, Kiwa 549, ISO 727

Pipe BS 5391 EN 61386-1 Class 1131

Adhesive BS 4346 Part 3

### **Colour**

Protec supplied ABS products are manufactured in Red, White and Grey Colours.

### **Temperature**

ABS is suitable for use over a wide temperature range from -40°C to +70°C.

### **Jointing of sampling pipe and their accessories**

Protec supplied 'Solvent Cement' for ABS sampling pipe is specially formulated to chemically weld pipes and fittings together. The solvent cement chemically melts the two surfaces to be joined, so that when they are fitted together, they form a homogenous mass, which then cures to form a weld. Note: This is not a glued joint. It is therefore important to choose the correct type of adhesive, as another type may be detrimental to the integrity of the system.

#### Jointing 'always':-

- a) Cut the pipe at right angles to its axis, and to the required length using the correct cutting tool.
- b) Dry fit the pipe to the socket of the fittings. When the pipe is fully home in the socket, draw a line around the pipe at the edge of the socket. Where this is not possible, measure the socket depth and draw a line at the corresponding point along the pipe. This will give a visual indication, to ensure that the pipe is fully pushed home in the socket.
- c) Apply the solvent cement with a suitably sized brush or the brush provided in the adhesive lid. Ensure that the area of the pipe up to the visual indicator is completely covered with an even layer of cement. This part of the operation must be done quickly and neatly, as the solvent must still be wet when the pipe and fitting is pushed together.
- d) Push the pipe and fittings together and hold in place for up to 30 seconds. When the joint is made, a bead of solvent cement will form around the outer joint of the pipe and socket. This excess cement should be wiped away leaving the outer part of the joint clean.

#### Jointing 'never':-

- a) Make joints in rain or wet conditions
- b) Use dirty brushes or cleaning rags, which are dirty or oily.
- c) Use the same brushes with different solvent cements.
- d) Dilute or thin solvent cements with cleaner.
- e) Leave solvent cement tins open. The contents will evaporate and the cement performance will be weakened.
- f) Use near naked lights, or smoke whilst jointing. Solvents are highly inflammable.
- g) Make joints in a confined space as solvents emit hazardous vapours which are dangerous when inhaled.

## Sampling Pipe Expansion and Contraction

Expansion or contraction of plastic pipe is caused by temperature change occurring within the pipe wall. When the operating temperature of a pipe is greater than when it was installed, then the pipe will expand. If the operating temperature is lower, then it will contract.

There are two factors to consider when calculating expansions or contractions in pipes.

- 1) Ambient temperature of the (air temp) environment when installing the pipe.
- 2) Change of temperature of pipe contents or environment following installation.

Any change of the above factors will affect the mid-wall temperature of the pipe, thus causing either expansion or contraction. The designer should make provision for pipe expansion and contraction based upon the type of pipes used and the temperature variations expected within the protected environment.

### Calculation Expansion/Contraction

1) The change in length due to contraction or expansion in a pipe system is determined by the following formula:

$$\Delta L = \Delta T \times L \times \alpha$$

Where  $\Delta L$  Expansion ( $\Delta L_e$ ) or contraction ( $\Delta L_c$ ) in mm

$\Delta T$  Difference in temperature between the installation and the operating temperatures in °C (= T operate - T install)

L Length of pipe when installed

$\alpha$  Relevant coefficient of expansion

#### Example:

Using information on the tables below, find the expansion and contraction on a 25mm diameter ABS pipe system, installed at 10°C. The maximum and minimum operating temperatures are 30°C and 8°C respectively. The overall length of the installation is 30m.

Step 1) Calculate temperature change for expansion and contraction:

$$\Delta T = 30 - 10 = +20^\circ\text{C.}$$

$$\Delta T = 8 - 10 = -2^\circ\text{C.}$$

Step 2) Now calculate expansion and contraction,

$$\text{Expansion } \Delta L_e = \Delta T \times L \times \alpha = 20 \times 30 \times 0.100 = 60\text{mm}$$

$$\text{Contraction } \Delta L_c = \Delta T \times L \times \alpha = -2 \times 30 \times 0.100 = -6\text{mm}$$

Step 3) In order to provide for the correct solution, it is necessary to take the greater value, regardless whether it is due to expansion or contraction.

i.e.  $\Delta L = 60\text{mm.}$

### Coefficient of Linear Expansion for Plastics

Material	Coefficient $\alpha$ x (10 <sup>-5</sup> m/m°C)	Length/Temp °C Equipment mm/m °C
PVC - U	7.8	0.78
ABS	10.1	0.100
P.P	15.0	0.150
P.E	20.0	0.200

The meaning of the above coefficients is for example: ABS will expand 0.100mm per metre, for every 10°C raised in mid-wall temp above the installation temperature.

### Expansion in mm from 1°C to 20°C for 1 metre Length Pipe

°C	ABS	
1	0.100	
2	0.200	
3	0.300	
4	0.400	
5	0.500	
6	0.600	
7	0.700	
8	0.800	
9	0.900	
10	1.000	
11	1.100	
12	1.200	
13	1.300	
14	1.400	
15	1.500	
16	1.600	
17	1.700	
18	1.800	
19	1.900	
20	2.000	


For the temperature range not on the chart, add the factors.

i.e. for ABS @ 37°C  
Add 20°C = 2.000

17°C = 1.700

37°C = 3.700


### Coefficient of Linear Expansion for other Materials

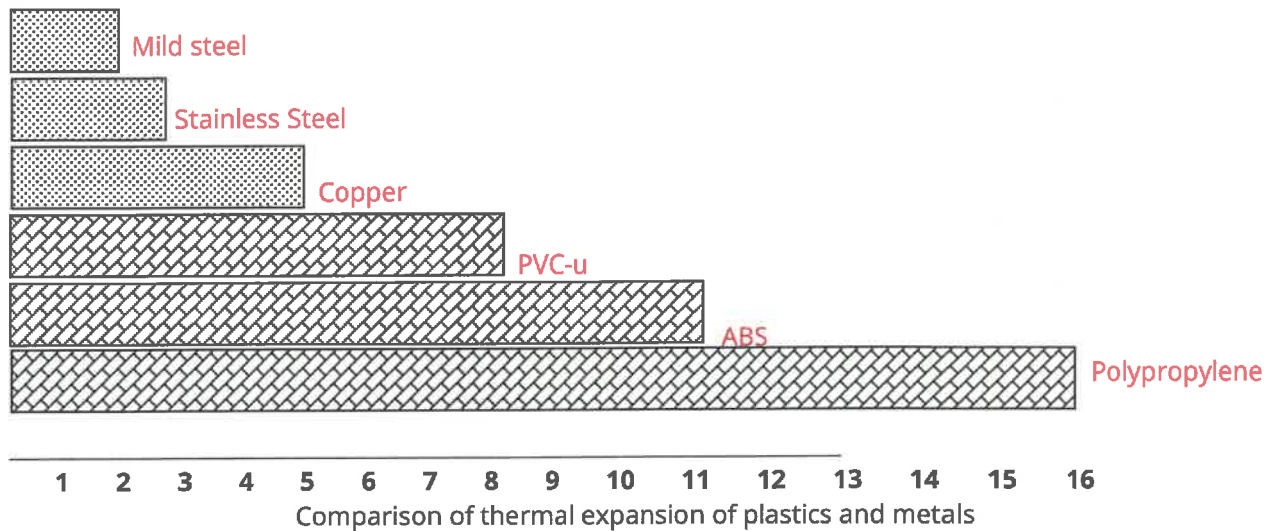

### How to Allow for Expansion or Contraction


Any change of length in a pipe system, whether it is expansion or contraction, will require compensation, so that any stresses generated by the change will not cause damage to the system, this can be achieved by installing Flexible Expansion Loops.

Recommendations for installation of 1m sampling pipe expansion loops:

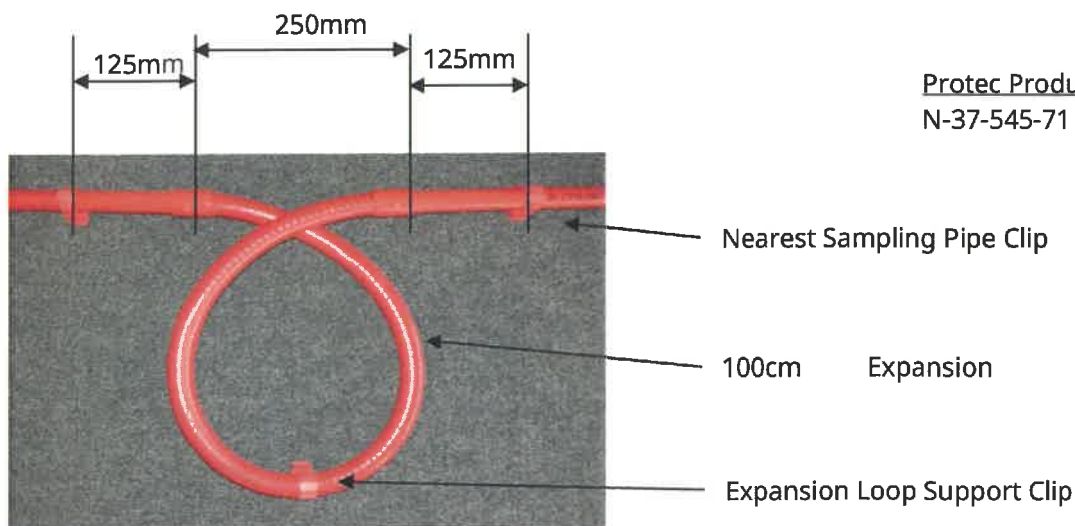

Expansion Loops are designed to compensate for linear expansion or contraction within a pipe system. It is recommended that sampling pipe clips be installed generally as per the detail above. The weight of the expansion loop should be supported to prevent excess stress on any coupling connections. Sampling pipe expansion loops should not be installed in an orientation that allows any moisture/condensation to be held within the loop.

### Flexible Loops when used to navigate structural obstructions

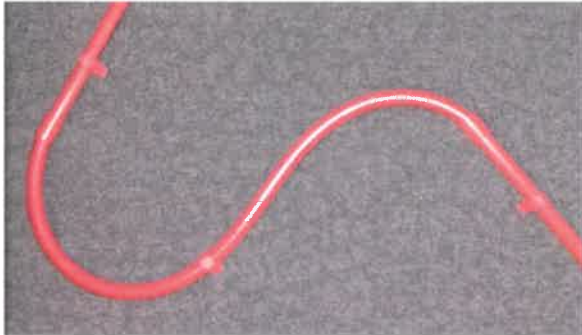

Protec Product Code:  
N-37-545-71

Flexible loops may be used to navigate pipe through difficult pipe routes and provide a simple and relatively inexpensive installation option. The flexibility of these bends also permits expansion or contraction to be compensated when multiple directional changes are required within a pipe system. (example pipe directional changes around structural steelwork).

The weight of the flexible section should be supported to prevent excess stress on any coupling connections. Flexible sections should not be installed in an orientation that allows any moisture/condensation to be held within the section.

### Sampling Pipe Clips, fixings and Labelling


All pipe clips/brackets need to be made with the inside diameter of the bracket marginally larger than that of the pipe outer diameter. This allows for free lineal movement of the pipe, and avoids inhibiting expansion or contraction. They should also be smooth, to avoid damage to the outer surface of the pipe. It should be noted that many of the 'caddie' type knock-on girder clips do not allow for lineal pipe movement as they 'grip' the sampling pipe and therefore, should not be used.



The Protec supplied sampling pipe clip for 25mm ABS sampling pipe is a two position 'locking' clip. The first locking position is really for 27mm sampling pipe but may be used for 25mm sampling pipe if the clip is installed facing upwards. The second locking position 'holds' the sampling pipe within the clip more firmly but still allows for lineal movement of the sampling pipe through the clip caused by expansion and contraction of the sampling pipe due to temperature changes. The clip may be installed in any orientation in this locking position.

### Bracket Spacing Intervals

ABS sampling pipes require regular support and the spacing of clips or brackets depends on the pipe used, temperature, and density of the material carried within the pipe. The exact type and spacing of sampling pipe fixings should be determined utilizing sampling pipe manufacturers recommendations. For 'general' ABS pipe installations, Protec would recommend a maximum of 1000mm spacing between sampling pipe clips. When temperature change is expected and therefore, expansion and contraction, Sampling pipe clips (as above) which allow lateral movement should always be used. 'Girder' or other similar rigid type clips that retain sampling pipe without allowing for lateral movement should not be used.



The system designer/installer should check that the sampling pipe installation is secured adequately to the building structure. Many types of sampling pipe and capillary pipe fixings are available and it should be ensured that the type & method selected is suitable for both the application and the environment.



## **Sampling Hole Identification**

Aspirating detection systems are now installed in an ever increasing variety of different applications, many of which replace standard point type smoke detectors or optical beam detectors. Often these applications include high ceiling spaces, where it is almost impossible to identify where the sampling holes are located and more importantly, if the sampling hole is the correct size.

For this reason Protec would recommend '**HIT's**' **Hole Identification Tags**.

Each HIT is colour coded to identify its specific sampling hole diameter. This colour coding allows accurate identification of the various sampling hole locations and true hole size for the benefit of commissioning & servicing engineers, clients and even project auditors.

A build-up of dust around a standard drilled sampling hole is common place due to the friction created by the airflow through the sampling hole. Each HIT incorporates a chamfered hole entry which is proven to significantly reduce this dust loading effect.

To assist the installers a common, 8mm diameter drill is all that is required for every sampling hole location.



### HIT Product Codes:

Product Code	Description
37-534-68	2.0mm - Purple HIT
37-535-69	2.5mm - Grey HIT
37-536-70	3.0mm - Yellow HIT
37-537-71	3.5mm - Blue HIT
37-538-72	4.0mm - Green HIT
37-539-73	4.5mm - Black HIT
37-540-74	5.0mm - White HIT
37-541-75	6.0mm - Brown HIT

As an alternative Sampling Hole Warning Labels could be used.



### **Warning Label**

Sampling hole warning labels are used to clearly identify the location of each sampling hole. Protec part code N23-039-37.

## Environmental & Condensation Considerations

It is very important to consider the effects of condensation on some aspirating detection systems with regards to the aspirating detector, the sampling pipe installation and the future servicing of such a system.

### Condensation with regards to the aspirating detector

Many aspirating detectors may cause false (unwanted) alarms when installed in environments where condensation may be permanent or be created due to changing environmental conditions of the protected area. This is particularly a problem for most 'optical' based aspirating detectors.

### Condensation with regards to the sampling pipe installation

Where condensation is permanently present or can be expected, the complete sampling pipe installation should be installed to allow a gradient where by any condensation formed inside the sampling pipe will, through gravity, drain to its lowest point where it can then be managed using a dedicated condensation drain point.

### Sampling Pipe Condensation Traps


Where high levels or permanent condensation is anticipated a 'Sampling Pipe Condensation Trap' may be placed within the sampling pipe installation. This trap should be located close to the aspirating detector, in a position that is 'off centre' from the detector sampling pipe inlet port. It must also be installed in the vertical plane to allow any condensation formed within the sampling pipe to be held in the sampling pipe condensation trap. A sampling pipe condensation trap will be required on each sampling pipe where condensation may be expected.

### Typical Condensation Traps

Protec part code: 37-584-14-BIS



Protec part code 45-023-04  
Standard  
45-023-04-C  
self-draining.

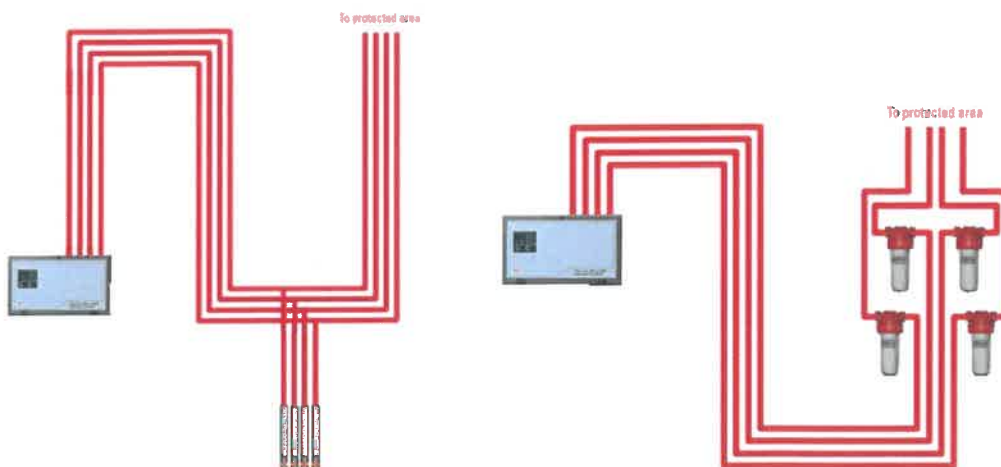


Typical Condensation Trap Installations.

### Sampling Pipe Holes.

Normally sampling holes are drilled into the sampling pipe on the bottom (or lower) face of the sampling pipe. However, where condensation may be present it is an advantage to drill the sampling holes on the side wall of the sampling pipe ensuring as much free space as possible remains around the area of the sampling hole. This should prevent any sampling holes becoming blocked when condensation is formed by water droplets and even 'streams' of condensation droplets within the sampling pipe.


'Revised' location of drilled sampling hole within sampling pipe when condensation may be expected. Thereby, not allowing any condensation to restrict or block any sampling holes.

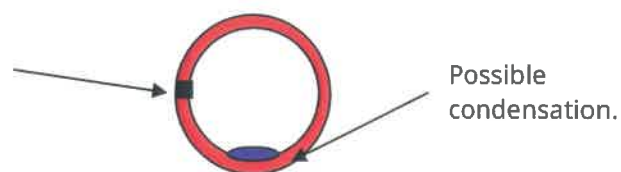

Please note: The above techniques of condensation management are for guidance only, other alternatives may be more suitable for each specific application and therefore, the designer should consider the best solution for the application.

### Intumescent Fire Stop Collar

Sometimes, during the installation of a network of sampling pipes it is necessary to pass through a fire resistant wall or structure (such as a plant-room, ceiling slab or lift shaft). If this is necessary, then it is good practice to install two 'Intumescent Fire Stop Collars' one either side of the breach of the fire resistant wall/structure on each sampling pipe that penetrates the fire wall as per the detail below.

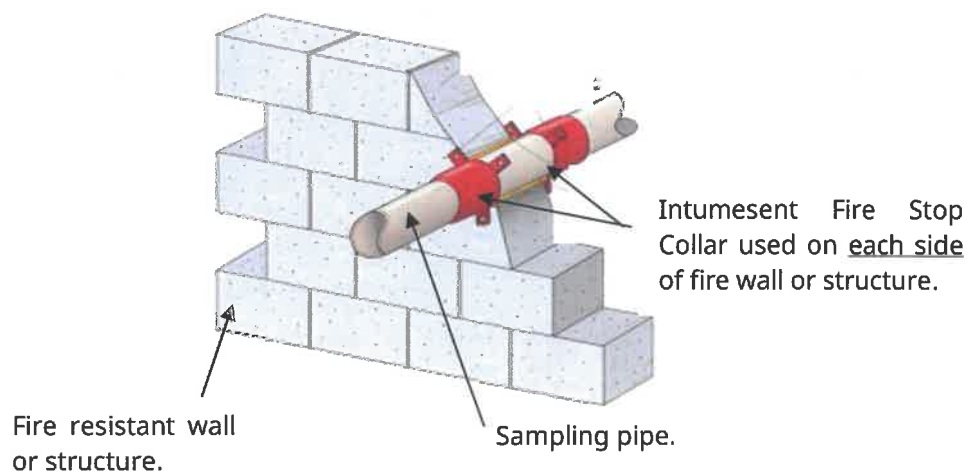


## Sampling Pipe Dust Management


### In-line Filters

All optical based aspirating detectors can provide unwanted (false) alarms from dust. Due to the sub-micron combustion particle size detected within Cloud chamber based aspirating detectors, they cannot false alarm from dust. However, when airborne dust is excessive, this dust needs to be 'managed' to prevent any internal blockages of the actual detector.

The type of dust filter required is dependent upon the expected amount of dust for the specific application. One option for dust management is the Protéc 3 stage in-line dust filter which contains a fine particle filter (greater than 5 micron), a medium particle filter (greater than 10 micron) and a course particle filter (greater than 16 micron). Protéc part code 61-986-F01. Other variants on filter grading are available on request.

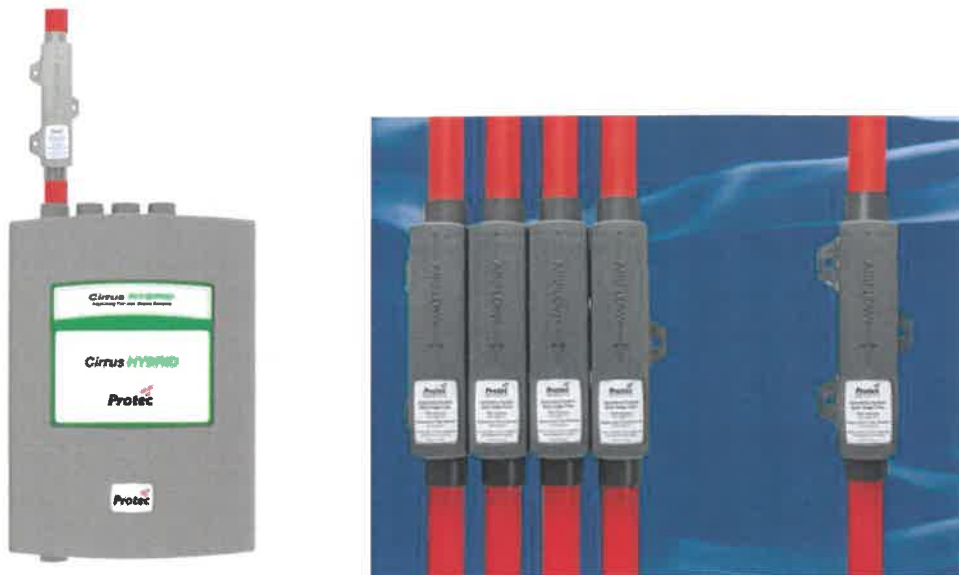

An alternative to the above where excessive dust can be expected is the Protéc Heavy Duty in-line sampling pipe dust filter. Protéc part number (45-023-04 Standard, 45-023-04-C self-draining).

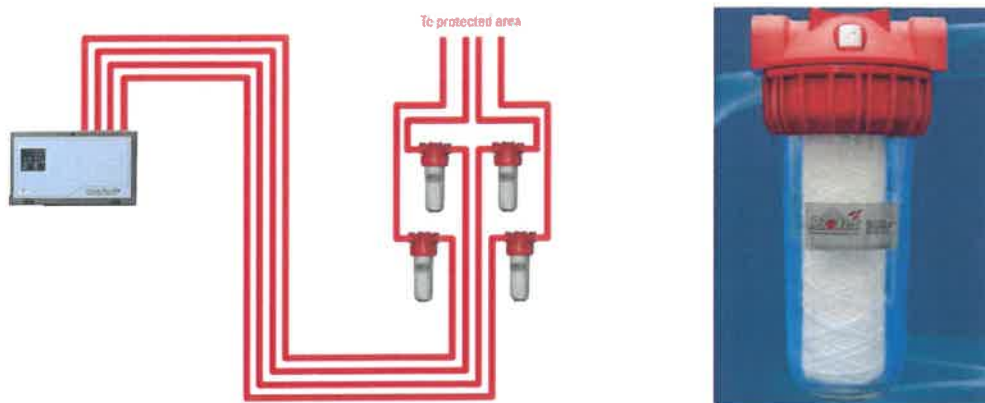

Typical installation of Heavy Duty In-line sampling pipe filter.

Protéc recommend the installation of suitable in-line pipe 'dust filters' in all sampling pipes installed.

### Pipe Purging Systems

In some applications, it may be necessary to install manual or automated sampling pipe cleaning systems.


If a manual system is used, the designer should consider a purpose made connection point close to the detector to allow the connection of a pipe cleaning device (compressor/vacuum).

If an automated system is used, the designer should consider the location, connection to the sampling pipe and operation of the purging system.

In either option detailed above, the designer should consider the time interval between pipe purging actions and the pipe pressures that are used for the purging process, with regards to the suitability of the sampling pipe and accessories. Additionally, the designer should consider the pipe installation fixing are correctly specified for any additional stresses that may be created by the frequent operation of the purging system.



Extreme example of pipes being impeded by excessive

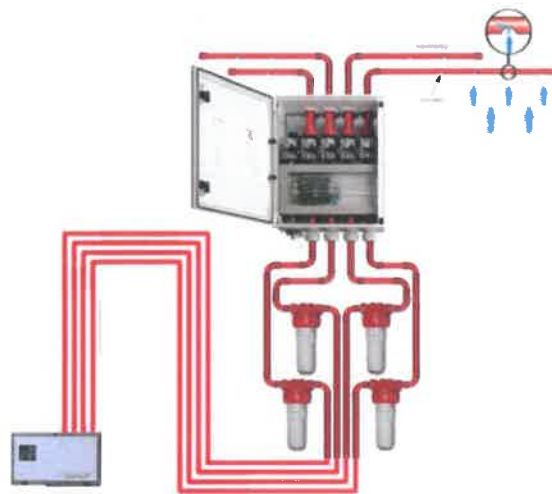

Protec Cirrus Pro detector with typical pipe purging unit connection

Pipe purging units contain programmers which allow pre-determined time periods between purging operations. These can typically be hourly, daily, weekly monthly etc.

**Important Design Note:** The designer should also consider that pipe purging, where air is forced up the pipe local to the detector and into the application; should not be used in food preparation or other sensitive area application where dust from inside the pipe may contaminate the product, process or area. In this case, the pipe should be cleaned by a vacuum type process where the vacuum is used to draw air from the protected space to a location before the actual aspirating detector.

For further information on pipe purging systems please contact Protec Fire & Security Group.


## **Extended or Capillary Sampling Pipes**

All extended or capillary sampling pipe and fittings should be low-pressure loss and be of a smooth bore to prevent turbulence of flow. The selected extended or capillary sampling pipe should be suitable for the environment in which it is to be installed.


Particular attention should be made to the length of either extended or capillary sampling points as these can create flow restrictions and therefore all designs should be verified by sampling pipe calculations. It is imperative all sampling holes in extended or capillary sampling points should be drilled out to the correct hole size, based on the sampling pipe calculations.

A list of approved capillary sampling pipe accessories is available on the 'Protec Sampling Pipe' data sheet.

### **Extended Sampling Point**

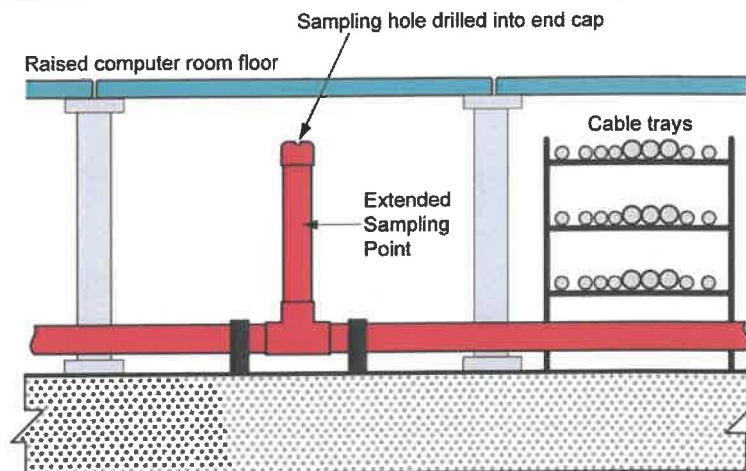

### **Capillary Sampling Points**

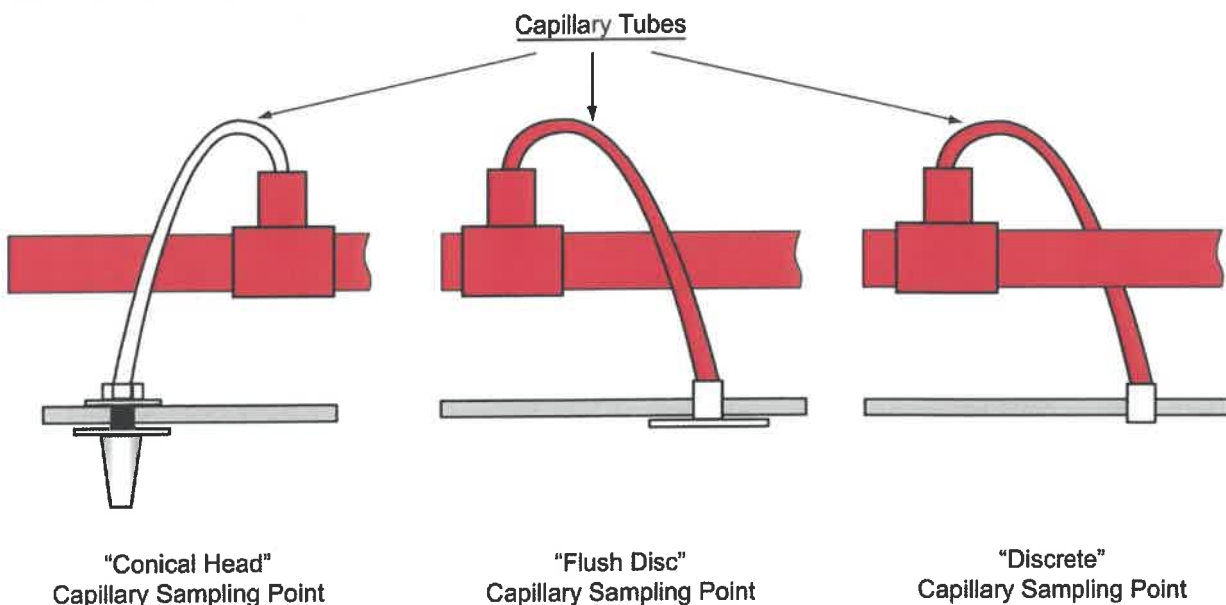

## Sampling Pipe 'Maintenance Test Points' Installation


Definition: A test point provided beyond the last sampling point, to test the integrity of the pipe work. Such a test point is closed in normal operation and is not subject to the maximum transport time.

Where sampling pipes are installed at high levels or within enclosed voids or compartments it may be necessary to install sampling pipe 'Test Points.'

These 'Test points' should be installed at the end of each sampling pipe array. Test Points are used to provide a dedicated orifice into the sampling pipe in order that the entire length of pipe can be tested during system servicing. Once testing is complete the 'Test Point' should be re-sealed as it does not form part of the sampling pipe detection system. If sampling holes cannot be accessed for testing purposes during service visits and the dedicated sampling pipe Test Point is used to test the pipe continuity, then additionally the detector airflow values shall be checked to confirm there is no change in flow values from the commissioned status.

As 'Test Points' do not form part of the sampling pipe detection system the transport time taken from the 'Test Point' to the detector is not restricted. However, the transport time taken from each 'test point' should be recorded and repeated on each visit with any changes in time investigated.

All sampling pipe 'Test Points' should be installed in safe and secure locations and should be made from a material suitable for the environment in which it is to be installed.

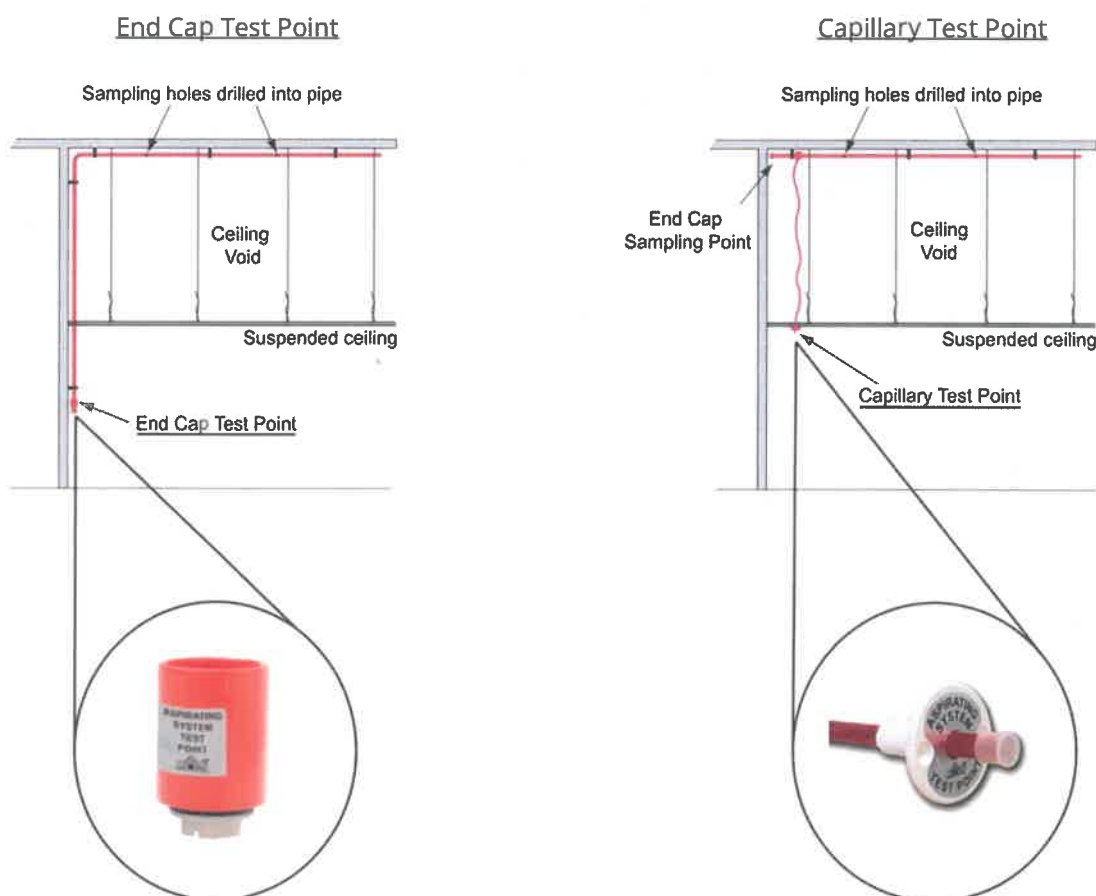

## **References**

1. British Standards BS5839-1:2017
2. FIA Code of Practice Issue 3 February 2012
3. Protec Generic Design & Installation Guide
4. Protec Design Guides & Disclosures (located on [www.protec.co.uk](http://www.protec.co.uk))



## **Disclaimer**

Any recommendation provided by Protec Fire & Security Group Ltd is merely an indication of the system design considered to be good practice to provide the most suitable solution to meet the needs of the common application environments described.

In some cases the recommendations or system design provided may not suit the unique set of conditions experienced in a particular application environment. Protec Fire & Security Group Ltd has no knowledge of nor has undertaken any survey or inspection of any particular conditions of any particular site, installation or environment to meet any particular application. Any design undertaken or recommendation provided are based upon the information provided by the Client and is carried out in good faith. In the event of the Client failing to provide Protec Fire & Security Group Ltd with all details necessary to provide an accurate design Protec Fire & Security Group Ltd shall incur no responsibility or penalty for any failure associated with or arising from any design produced nor shall Protec Fire & Security Group Ltd be liable for any damages arising whether in contract or tort. Furthermore, Protec Fire & Security Group Ltd is unable to provide any warranty as to the suitability or performance of any such recommendation in respect of the system design outlined herein. Protec Fire & Security Group Ltd has not assessed the recommendation on system design for compliance with any local codes or local standards that may apply nor have any tests been conducted to assess the suitability (or otherwise) of any recommendations or system design provided by Protec Fire & Security Group Ltd.

Any person or organization accessing or using a recommendation or system design should, at its own cost and expense, procure that any such recommendation or system design complies in all respects with the provision of all legislation, Acts of Parliament, regulations, rules and by-laws for the time being in force and all orders or directions which may be made or given by any statutory or any other competent authority in respect of or affecting the recommendation or system design in any jurisdiction in which it may be implemented.

Protec Fire & Security Group Ltd systems/products must only be installed, configured and used strictly in accordance with Protec Fire & Security Group Ltd's General Terms and Conditions of Sale, User Manuals and product documents available from Protec Fire & Security Group Ltd. Protec Fire & Security Group Ltd accepts no liability for the performance of the recommendation or system design or for any products utilised in the implementation of the recommendation or system design, other than as detailed within Protec Fire & Security Group Ltd's General Terms and Conditions of Sale, Use, manual and product information documents.

No statement of fact, drawing or representation made by Protec Fire & Security Group Ltd either in this document or orally in relation to this recommendation or system design is to be construed as a misrepresentation, undertaking or warranty.

Protec Fire & Security Group Ltd excludes any liability for all direct, indirect and consequential damages however arising to the maximum extent permitted by law. For the purposes of this clause, consequential damages shall include, but not be limited to, loss of profit or goodwill or similar financial loss or any payment made or due to any third party.

Recommendations on system design are provided exclusively to assist in the design of systems using Protec Fire & Security Group Ltd products. No portion of this recommendation or system design can be reproduced without prior approval in writing from Protec Fire & Security Group Ltd. Copyright and any associated intellectual property rights in any such recommendation or system design or documentation remains the property of Protec Fire & Security Group Ltd.

**BLANK PAGE**



**Protec Fire & Security Group, Protec House, Churchill Way, Nelson, Lancashire, BB9 6RT**

© 2018 Protec Fire & Security Group

Company Policy is one of continuous improvement, we reserve the right to change specification without prior notice

Tel: +44 1282 717171 Web: [www.protec.co.uk](http://www.protec.co.uk)

MED2201 Issue 0